



IEC 61400-25-4

Edition 2.0 2016-11  
REDLINE VERSION

# INTERNATIONAL STANDARD



---

Wind **turbines** energy generation systems –  
Part 25-4: Communications for monitoring and control of wind power plants –  
Mapping to communication profile

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

ICS 27.180

ISBN 978-2-8322-3668-0

**Warning! Make sure that you obtained this publication from an authorized distributor.**

## CONTENTS

|                                                                                                           |               |
|-----------------------------------------------------------------------------------------------------------|---------------|
| FOREWORD .....                                                                                            | 12            |
| INTRODUCTION .....                                                                                        | 15            |
| 1 Scope .....                                                                                             | 16            |
| 2 Normative references .....                                                                              | 17            |
| 3 Terms and definitions .....                                                                             | 20            |
| 4 Abbreviated terms .....                                                                                 | 21            |
| 5 General overview .....                                                                                  | 22            |
| 5.1 General .....                                                                                         | 22            |
| 5.2 Mapping to protocol stacks .....                                                                      | 23            |
| 5.3 Services of IEC 61400-25-3 mapped to protocol stacks .....                                            | 24            |
| Annex A (normative) Specific communication service mapping – Definition and mapping to Web Services ..... | 27            |
| A.1 General .....                                                                                         | 27            |
| A.1.1 Introduction to definition and mapping to Web Services .....                                        | 27            |
| A.1.2 Scope of the definition and mapping to Web Services .....                                           | 27            |
| A.1.3 The mapping architecture .....                                                                      | 27            |
| <del>A.2 Reference specific to Web services .....</del>                                                   | <del>30</del> |
| A.2 Mapping of the IEC 61400-25 Information Model to Web Services .....                                   | 30            |
| A.2.1 General introduction to <del>Annex A</del> mapping to web services .....                            | 30            |
| <del>A.4.2 SERVER class .....</del>                                                                       | <del>33</del> |
| <del>A.4.3 LOGICAL-DEVICE class .....</del>                                                               | <del>33</del> |
| <del>A.4.4 LOGICAL-NODE class .....</del>                                                                 | <del>33</del> |
| <del>A.4.5 DATA class .....</del>                                                                         | <del>33</del> |
| <del>A.4.6 DATA-SET class .....</del>                                                                     | <del>33</del> |
| A.2.2 DATA OBJECT class .....                                                                             | 33            |
| A.2.3 DATA ATTRIBUTE definition .....                                                                     | 34            |
| <del>A.4.8 DAType class .....</del>                                                                       | <del>33</del> |
| <del>A.4.9 REPORT-CONTROL-BLOCK class .....</del>                                                         | <del>33</del> |
| <del>A.4.10 BUFFERED-REPORT-CONTROL-BLOCK class (BRCB) .....</del>                                        | <del>33</del> |
| <del>A.4.11 UNBUFFERED-REPORT-CONTROL-BLOCK class (URCB) .....</del>                                      | <del>33</del> |
| <del>A.4.12 LOG-CONTROL-BLOCK class (LCB) .....</del>                                                     | <del>33</del> |
| <del>A.4.13 LOG class .....</del>                                                                         | <del>33</del> |
| <del>A.3 Abbreviated terms .....</del>                                                                    | <del>34</del> |
| A.3 Mapping of the Information Exchange Model to Web Services .....                                       | 34            |
| A.3.1 General .....                                                                                       | 34            |
| A.3.2 SERVER class service mapping .....                                                                  | 34            |
| A.3.3 LOGICAL-DEVICE class service mapping .....                                                          | 41            |
| A.3.4 LOGICAL-NODE class services mapping .....                                                           | 42            |
| A.3.5 DATA class services mapping .....                                                                   | 45            |
| A.3.6 DATA-SET class services mapping .....                                                               | 56            |
| A.3.7 REPORT-CONTROL-BLOCK (RCB) class services mapping .....                                             | 63            |
| A.3.8 LOG-CONTROL-BLOCK (LCB) class services mapping .....                                                | 81            |
| A.3.9 LOG class services mapping .....                                                                    | 84            |
| A.3.10 CONTROL class services mapping .....                                                               | 89            |
| A.4 Protocol stack details .....                                                                          | 102           |
| A.5 The WSDL specification for the definition and mapping to Web Services .....                           | 103           |

## Annex B (normative) Specific communication service mapping – Mapping to OPC

|                                                                               |     |
|-------------------------------------------------------------------------------|-----|
| XML-DA .....                                                                  | 138 |
| B.1 General.....                                                              | 138 |
| B.1.1 Introduction to mapping to OPC XML-DA .....                             | 138 |
| B.1.2 Scope for the mapping to OPC XML-DA.....                                | 138 |
| B.1.3 The mapping architecture .....                                          | 138 |
| <del>B.2 Reference specific to OPC XML-DA mapping .....</del>                 |     |
| B.2 Mapping of the IEC 61400-25 Information Model to OPC XML-DA.....          | 142 |
| B.2.1 Mapping of IEC 61400-25-2 Information Model classes to OPC XML-DA ..... | 142 |
| B.2.2 Server .....                                                            | 142 |
| B.2.3 Logical Device .....                                                    | 143 |
| B.2.4 Logical Node .....                                                      | 143 |
| B.2.5 Data Object .....                                                       | 143 |
| B.2.6 Data Attribute .....                                                    | 145 |
| <del>B.3 Abbreviated terms .....</del>                                        |     |
| B.3 Mapping of the Information Exchange Model to OPC XML-DA services.....     | 151 |
| B.3.1 General .....                                                           | 151 |
| B.3.2 Association model (informative) .....                                   | 151 |
| <del>B.5.3 Server class model .....</del>                                     |     |
| B.3.3 Server class services – GetServerDirectory .....                        | 155 |
| <del>B.5.4 Logical device class model .....</del>                             |     |
| B.3.4 Logical device class services – GetLogicalDeviceDirectory.....          | 157 |
| B.3.5 Logical node class models services .....                                | 159 |
| B.3.6 Data class models services .....                                        | 161 |
| B.3.7 Data set class model (informative) .....                                | 169 |
| B.3.8 Report class model .....                                                | 173 |
| B.3.9 Control model .....                                                     | 178 |
| B.4 Protocol stack details .....                                              | 188 |

## Annex C (normative) Specific communication service mapping – Mapping to ISO 9506

|                                                                                                   |     |
|---------------------------------------------------------------------------------------------------|-----|
| specified in IEC 61850-8-1 .....                                                                  | 190 |
| C.1 General.....                                                                                  | 190 |
| C.1.1 Introduction to mapping to ISO 9506 specified in IEC 61850-8-1.....                         | 190 |
| C.1.2 Scope of the mapping to ISO 9506 specified in IEC 61850-8-1 .....                           | 190 |
| C.1.3 The mapping architecture .....                                                              | 190 |
| <del>C.2 Reference specific to Annex C .....</del>                                                |     |
| C.2 Mapping of the IEC 61400-25 Information Model to ISO 9506 as specified in IEC 61850-8-1 ..... | 193 |
| C.2.1 General .....                                                                               | 193 |
| C.2.2 Extended Logging services .....                                                             | 195 |
| <del>C.3 Abbreviated terms for Annex C .....</del>                                                |     |
| C.3 Protocol stack details .....                                                                  | 196 |
| C.3.1 General .....                                                                               | 196 |
| C.3.2 A-Profile .....                                                                             | 196 |
| C.3.3 TCP/IP T-Profile .....                                                                      | 197 |
| <del>C.5 Mapping of the extended Information Exchange Model to ISO 9506 .....</del>               |     |

## Annex D (normative) Specific communication service mapping – Mapping to

|                                                                                       |     |
|---------------------------------------------------------------------------------------|-----|
| IEC 60870-5-104 specified in IEC TS 61850-80-1 .....                                  | 198 |
| D.1 General.....                                                                      | 198 |
| D.1.1 Introduction to mapping to IEC 60870-5-104 specified in IEC TS 61850-80-1 ..... | 198 |

|                                                                                                    |                                                                                                                         |     |
|----------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------|-----|
| D.1.2                                                                                              | Scope of the mapping to IEC 60870-5-104 specified in IEC TS 61850-80-1 .....                                            | 198 |
| D.1.3                                                                                              | The mapping architecture .....                                                                                          | 198 |
| <del>D.2 References specific to the mapping to IEC 60870-5-104 .....</del>                         |                                                                                                                         |     |
| D.2                                                                                                | Mapping of the IEC 61400-25 Information Model to IEC 60870-5-104 as specified in IEC TS 61850-80-1.....                 | 202 |
| D.2.1                                                                                              | General .....                                                                                                           | 202 |
| D.2.2                                                                                              | Logical Device IM class mapping .....                                                                                   | 203 |
| D.2.3                                                                                              | Logical Node IM class mapping .....                                                                                     | 204 |
| <del>D.3 Abbreviated terms .....</del>                                                             |                                                                                                                         |     |
| D.3                                                                                                | Mapping of IEC 61400-25 Information Model data to IEC 60870-5-104 .....                                                 | 204 |
| D.3.1                                                                                              | Mapping of the Common Data Classes (CDC) .....                                                                          | 204 |
| D.4                                                                                                | Mapping of the Information Exchange Model to IEC 60870-5-104 services.....                                              | 215 |
| D.4.1                                                                                              | List of service models and corresponding mappings .....                                                                 | 215 |
| D.4.2                                                                                              | Control class mapping .....                                                                                             | 216 |
| D.5                                                                                                | Protocol stack selections for IEC 60870-5-104 (Protocol stack details) .....                                            | 229 |
| D.5.1                                                                                              | General .....                                                                                                           | 229 |
| D.5.2                                                                                              | Structure of application data .....                                                                                     | 229 |
| D.5.3                                                                                              | IEC 60870-5-104 Interoperability .....                                                                                  | 229 |
| D.6                                                                                                | Use of SCL (Substation Configuration Language) extension to include IEC 60870-5-101/104 information (informative) ..... | 242 |
| D.6.1                                                                                              | General .....                                                                                                           | 242 |
| D.6.2                                                                                              | SCL information model hierarchy .....                                                                                   | 242 |
| D.6.3                                                                                              | IEC 60870-5-101/104 Private section syntax.....                                                                         | 242 |
| D.6.4                                                                                              | IEC 60870-5-104 communication parameters configuration using SCL.....                                                   | 242 |
| Annex E (normative) Specific communication service mapping – Mapping to DNP3 .....                 |                                                                                                                         | 243 |
| E.1                                                                                                | General.....                                                                                                            | 243 |
| E.1.1                                                                                              | Introduction to mapping to DNP3 .....                                                                                   | 243 |
| E.1.2                                                                                              | Scope for the mapping to DNP3.....                                                                                      | 243 |
| E.1.3                                                                                              | Mapping architecture .....                                                                                              | 243 |
| <del>E.2 References specific to DNP3 services.....</del>                                           |                                                                                                                         |     |
| E.2                                                                                                | Mapping of the IEC 61400-25 Information Model to DNP3.....                                                              | 247 |
| <del>E.4.1 Relationship of Common Data Class and Data Set Prototypes.....</del>                    |                                                                                                                         |     |
| <del>E.4.2 Relationship of Quality Mapping to SQ2.....</del>                                       |                                                                                                                         |     |
| <del>E.4.3 CDC Measured Value (MV).....</del>                                                      |                                                                                                                         |     |
| E.2.1                                                                                              | Mapping of IEC 61850-7-3 inherited common Data Classes .....                                                            | 247 |
| E.2.2                                                                                              | CDC Setpoint Parameter Value (SPV) .....                                                                                | 247 |
| E.2.3                                                                                              | CDC Status Value (STV).....                                                                                             | 249 |
| E.2.4                                                                                              | CDC Alarm (ALM).....                                                                                                    | 251 |
| E.2.5                                                                                              | CDC Command (CMD).....                                                                                                  | 252 |
| E.2.6                                                                                              | CDC Event Counting (CTE) .....                                                                                          | 254 |
| E.2.7                                                                                              | CDC State Timing (TMS) .....                                                                                            | 255 |
| <del>E.4.10 CDC Single Point Status (SPS).....</del>                                               |                                                                                                                         |     |
| <del>E.4.11 CDC Integer Status (INS).....</del>                                                    |                                                                                                                         |     |
| <del>E.4.12 CDC Controllable Single Point (SPS).....</del>                                         |                                                                                                                         |     |
| <del>E.4.13 CDC Controllable Integer Status (INC).....</del>                                       |                                                                                                                         |     |
| <del>E.4.14 CDC Binary Counter Reading (BCR).....</del>                                            |                                                                                                                         |     |
| <del>E.4.15 CDC Controllable Analogue set point (APC).....</del>                                   |                                                                                                                         |     |
| <del>E.4.16 CDC Phase to ground related to measured value of a three-phase system (WYE).....</del> |                                                                                                                         |     |

|                                                                                                 |     |
|-------------------------------------------------------------------------------------------------|-----|
| <del>E.4.17 CDC Phase to phase related measured value of a three phase system (DEL)</del> ..... |     |
| E.2.8 CDC Device Name Plate (WDPL).....                                                         | 259 |
| <del>E.4.19 CDC Logical Node Name Plate (LPL)</del> .....                                       |     |
| E.2.9 CDC Alarm Set Status ( <del>ASS</del> <b>AST</b> ) .....                                  | 260 |
| <del>E.4.21 Relationship of Data Class Attributes and Data Set Descriptors</del> .....          |     |
| <del>E.4.22 Role of the DNP Users Group</del> .....                                             |     |
| <del>E.3 Abbreviated terms</del> .....                                                          |     |
| E.3 Mapping of the Information Exchange Model to DNP3 services .....                            | 262 |
| <del>E.6 Protocol stack details</del> .....                                                     |     |
| <del>E.6.1 DNP DEVICE PROFILE DOCUMENT</del> .....                                              |     |
| Annex F (normative) Time synchronization .....                                                  | 264 |
| F.1 General.....                                                                                | 264 |
| F.2 A-Profile .....                                                                             | 264 |
| F.3 T-Profile.....                                                                              | 264 |
| Annex G (informative) Interfaces – Implementation considerations .....                          | 265 |
| G.1 General.....                                                                                | 265 |
| G.2 Example interfaces of a real system.....                                                    | 265 |
| <b>Bibliography</b> .....                                                                       | 267 |
| Figure 1 – Conceptual communication model of IEC 61400-25 series .....                          | 17  |
| Figure 2 – Communication profiles .....                                                         | 24  |
| Figure A.1 – Mapping architecture (conceptual) .....                                            | 28  |
| Figure A.2 – Naming structure applied in the IEC 61400-25 series (conceptual).....              | 31  |
| Figure A.3 – Client behavior in the reporting service (conceptual).....                         | 64  |
| Figure A.4 – Server behavior in the reporting service (conceptual).....                         | 66  |
| Figure A.5 – Reporting Services mechanism (conceptual).....                                     | 67  |
| Figure B.1 – Mapping architecture (conceptual) .....                                            | 139 |
| Figure B.2 – Differences between OPC XML-DA and IEC Information Model timestamp.....            | 149 |
| Figure B.3 – Sequence of services to establish an association.....                              | 154 |
| Figure B.4 – CreateDataSet sequence of services .....                                           | 171 |
| Figure C.1 – Mapping architecture (conceptual) .....                                            | 191 |
| Figure D.1 – Mapping architecture (conceptual) .....                                            | 199 |
| Figure D.2 – Direct Control with Normal Security with status update – positive case .....       | 217 |
| Figure D.3 – Direct Control with Normal Security in general – negative case a) .....            | 218 |
| Figure D.4 – Direct Control with Normal Security in general – negative case b) .....            | 218 |
| Figure D.5 – Direct Control with Normal Security with status update – negative case c).....     | 219 |
| Figure D.6 – Direct Control with Normal Security without status update – positive case .....    | 220 |
| Figure D.7 – Direct Control with Enhanced Security – positive case .....                        | 221 |
| Figure D.8 – Direct Control with Enhanced Security – negative case c).....                      | 222 |
| Figure D.9 – Direct Control with Enhanced Security – negative case d) .....                     | 223 |
| Figure D.10 – SBOw control – positive case .....                                                | 224 |
| Figure D.11 – SBOw control – negative case a) .....                                             | 224 |
| Figure D.12 – SBOw control – negative case b) .....                                             | 225 |
| Figure D.13 – SBOw control – negative case c) .....                                             | 226 |

|                                                                                 |               |
|---------------------------------------------------------------------------------|---------------|
| Figure D.14 – SBO with Enhanced Security – positive case .....                  | 227           |
| Figure D.15 – SBO with Enhanced Security – negative case a).....                | 228           |
| Figure D.16 – SBO with Enhanced Security – negative case b).....                | 229           |
| Figure E.1 – Mapping architecture (conceptual) .....                            | 244           |
| Figure G.1 – Implementation issues (example) .....                              | 266           |
| Table 1 – Mapping overview of IEC 61400-25-3 services .....                     | 25            |
| Table A.1 – Web Services mapping overview of IEC 61400-25 IM and IEM.....       | 29            |
| Table A.2 – Mapping the IEC 61400-25 IM to Web Services.....                    | 30            |
| <del>Table A.3 – Mapping of IEC 61400-25 data attribute basic types .....</del> | <del>33</del> |
| Table A.3 – XML schema for wind power information model.....                    | 33            |
| Table A.4 – Server class services mapped to Web Services .....                  | 34            |
| Table A.5 – GetServerDirectoryRequest .....                                     | 35            |
| Table A.6 – GetServerDirectoryResponse.....                                     | 36            |
| Table A.7 – AssociateRequest .....                                              | 37            |
| Table A.8 – AssociateResponse .....                                             | 38            |
| Table A.9 – ReleaseRequest.....                                                 | 39            |
| Table A.10 – ReleaseResponse .....                                              | 39            |
| Table A.11 – AbortRequest.....                                                  | 40            |
| Table A.12 – AbortResponse .....                                                | 40            |
| Table A.13 – LOGICAL-DEVICE service mapping .....                               | 41            |
| Table A.14 – GetLogicalDeviceDirectoryRequest .....                             | 41            |
| Table A.15 – GetLogicalDeviceDirectoryResponse .....                            | 42            |
| Table A.16 – LOGICAL-NODE mapping .....                                         | 42            |
| Table A.17 – GetLogicalNodeDirectoryRequest .....                               | 43            |
| Table A.18 – GetLogicalNodeDirectoryResponse .....                              | 44            |
| Table A.19 – GetAllDataValuesRequest.....                                       | 44            |
| Table A.20 – GetAllDataValuesResponse .....                                     | 45            |
| Table A.21 – Data mapping.....                                                  | 45            |
| Table A.22 – GetDataValuesRequest.....                                          | 46            |
| Table A.23 – GetDataValuesResponse .....                                        | 47            |
| Table A.24 – SetDataValuesRequest .....                                         | 50            |
| Table A.25 – SetDataValuesResponse.....                                         | 50            |
| Table A.26 – GetDataDirectoryRequest .....                                      | 51            |
| Table A.27 – GetDataDirectoryResponse.....                                      | 52            |
| Table A.28 – GetDataDefinitionRequest.....                                      | 53            |
| Table A.29 – GetDataDefinitionResponse .....                                    | 53            |
| Table A.30 – DATA-SET mapping .....                                             | 56            |
| Table A.31 – GetDataSetValuesRequest.....                                       | 57            |
| Table A.32 – GetDataSetValuesResponse .....                                     | 57            |
| Table A.33 – SetDataSetValuesRequest .....                                      | 59            |
| Table A.34 – SetDataSetValuesResponse .....                                     | 59            |
| Table A.35 – CreateDataSetRequest .....                                         | 60            |

|                                                          |               |
|----------------------------------------------------------|---------------|
| Table A.36 – CreateDataSetResponse .....                 | 61            |
| Table A.37 – DeleteDataSetRequest .....                  | 61            |
| Table A.38 – DeleteDataSetResponse .....                 | 62            |
| Table A.39 – GetDataSetDirectoryRequest .....            | 62            |
| Table A.40 – GetDataSetDirectoryResponse .....           | 63            |
| <del>Table A.41 – AddSubscriptionRequest .....</del>     | <del>63</del> |
| Table A.41 – Report control block services mapping ..... | 64            |
| <del>Table A.42 – AddSubscriptionResponse .....</del>    | <del>64</del> |
| Table A.42 – ReportFormat .....                          | 68            |
| <del>Table A.43 – RemoveSubscriptionRequest .....</del>  | <del>68</del> |
| Table A.43 – GetBRCBValuesRequest .....                  | 69            |
| <del>Table A.44 – RemoveSubscriptionResponse .....</del> | <del>69</del> |
| Table A.44 – GetBRCBValuesResponse .....                 | 70            |
| Table A.45 – SetBRCBValuesRequest .....                  | 73            |
| Table A.46 – SetBRCBValuesResponse .....                 | 74            |
| Table A.47 – GetURCBValuesRequest .....                  | 75            |
| Table A.48 – GetURCBValuesResponse .....                 | 76            |
| Table A.49 – SetURCBValuesRequest .....                  | 78            |
| Table A.50 – SetURCBValuesResponse .....                 | 79            |
| Table A.51 – ReportRequest .....                         | 80            |
| Table A.52 – ReportResponse .....                        | 81            |
| Table A.53 – LOG-CONTROL-BLOCK services mapping .....    | 81            |
| Table A.54 – GetLCBValuesRequest .....                   | 82            |
| Table A.55 – GetLCBValuesResponse .....                  | 82            |
| Table A.56 – SetLCBValuesRequest .....                   | 83            |
| Table A.57 – SetLCBValuesResponse .....                  | 84            |
| Table A.58 – Log class services mapping .....            | 84            |
| Table A.59 – GetLogStatusValuesRequest .....             | 85            |
| Table A.60 – GetLogStatusValuesResponse .....            | 85            |
| Table A.61 – QueryLogByTimeRequest .....                 | 86            |
| Table A.62 – QueryLogByTimeResponse .....                | 87            |
| Table A.63 – QueryLogAfterRequest .....                  | 87            |
| Table A.64 – QueryLogAfterResponse .....                 | 88            |
| Table A.65 – Control class services mapping .....        | 90            |
| Table A.66 – SelectRequest .....                         | 90            |
| Table A.67 – SelectResponse .....                        | 91            |
| Table A.68 – SelectWithValueRequest .....                | 92            |
| Table A.69 – SelectWithValueResponse .....               | 93            |
| Table A.70 – CancelRequest .....                         | 94            |
| Table A.71 – CancelResponse .....                        | 95            |
| Table A.72 – OperateRequest .....                        | 96            |
| Table A.73 – OperateResponse .....                       | 97            |
| Table A.74 – CommandTerminationRequest .....             | 98            |

|                                                                                               |                |
|-----------------------------------------------------------------------------------------------|----------------|
| Table A.75 – CommandTerminationResponse.....                                                  | 98             |
| Table A.76 – TimeActivatedOperateRequest.....                                                 | 99             |
| Table A.77 – TimeActivatedOperateResponse .....                                               | 100            |
| Table A.78 – TimeActivatedOperateTerminationRequest .....                                     | 101            |
| Table A.79 – TimeActivatedOperateTerminationResponse.....                                     | 101            |
| Table A.80 – AddCause parameter response .....                                                | 102            |
| Table A.81 – Protocol stack selections.....                                                   | 103            |
| Table B.1 – Mapping of IEC 61400-25-3 IEM service into OPC XML-DA services .....              | 139            |
| Table B.2 – Mapping of IEC 61400-25-2 IM classes to OPC XML-DA.....                           | 142            |
| Table B.3 – Server class attributes .....                                                     | 142            |
| Table B.4 – Logical Device Class attributes .....                                             | 143            |
| Table B.5 – Logical Node Class attributes.....                                                | 143            |
| Table B.6 – Data Object Class attributes .....                                                | 145            |
| Table B.7 – Data AttributeType (DAType) Class attributes .....                                | 146            |
| Table B.8 – Mapping of the attribute BasicTypes .....                                         | 146            |
| Table B.9 – New OPC XML-DA Error codes .....                                                  | 148            |
| Table B.10 – Timestamp mapping .....                                                          | 149            |
| Table B.11 – Mapping of the Quality attribute .....                                           | 150            |
| Table B.12 – Cookie parameter explanation.....                                                | 153            |
| Table B.13 – IEM GetServerDirectory mapping .....                                             | 155            |
| Table B.14 – IEM GetServerDirectory mapping detailed.....                                     | 156            |
| Table B.15 – IEM GetLogicalDeviceDirectory mapping.....                                       | 157            |
| Table B.16 – IEM GetLogicalDeviceDirectory mapping detailed .....                             | 157            |
| Table B.17 – GetLogicalDeviceDirectory negative response mapping to IEM<br>ServiceError ..... | 159            |
| Table B.18 – IEM GetLogicalNodeDirectory mapping .....                                        | 159            |
| Table B.19 – IEM GetLogicalNodeDirectory mapping detailed.....                                | 160            |
| Table B.20 – GetLogicalNodeDirectory negative response mapping to IEM<br>ServiceError .....   | 161            |
| Table B.21 – IEM GetDataValues mapping .....                                                  | 162            |
| Table B.22 – IEM GetDataValues mapping detailed .....                                         | 162            |
| Table B.23 – GetDataValues negative response mapping to IEM ServiceError.....                 | 164            |
| Table B.24 – IEM SetDataValues mapping.....                                                   | 164            |
| Table B.25 – IEM SetDataValues mapping detailed .....                                         | 164            |
| Table B.26 – SetDataValues negative response mapping to IEM ServiceError .....                | 166            |
| Table B.27 – IEM GetDataDirectory mapping .....                                               | 167            |
| Table B.28 – IEM GetDataDirectory mapping detailed.....                                       | 168            |
| Table B.29 – GetDataDirectory negative response mapping to IEM ServiceError .....             | 169            |
| Table B.30 – Mapping of CreateDataSet service parameters .....                                | 171            |
| Table B.31 – CreateDataSet negative response mapping to IEM ServiceError .....                | 171            |
| Table B.32 – GetDataSetValues negative response mapping to IEM ServiceError .....             | 172            |
| Table B.33 – SetDataSetValues negative response mapping to IEM ServiceError.....              | 172            |
| Table B.34 – OPC Subscription attributes' constrained value .....                             | 173            |
| <del>Table B.35 – AddSubscription service parameter constraints .....</del>                   | <del>173</del> |

|                                                                                                 |                |
|-------------------------------------------------------------------------------------------------|----------------|
| Table B.35 – Subscribe .....                                                                    | 175            |
| Table B.36 – <del>Mapping of AddSubscription service parameters</del> Subscription Cancel ..... | 177            |
| <del>Table B.37 – AddSubscription negative response mapping to IEM ServiceError .....</del>     |                |
| Table B.37 – Fault mapping to IEM ServiceError .....                                            | 177            |
| <del>Table B.38 – Mapping of RemoveSubscription service parameters .....</del>                  |                |
| Table B.38 – Mapping of Report service parameters .....                                         | 177            |
| Table B.39 – Control models supported in this mapping .....                                     | 178            |
| <del>Table B.40 – Report service parameters .....</del>                                         |                |
| Table B.40 – Control services supported .....                                                   | 178            |
| Table B.41 – Control model writable custom item properties .....                                | 180            |
| Table B.42 – AddCause mapping to OPC Error Code .....                                           | 181            |
| Table B.43 – Select request service mapping .....                                               | 182            |
| <del>Table B.44 – Control model writable custom item properties .....</del>                     | <del>165</del> |
| Table B.44 – SelectWithValue service parameter mapping .....                                    | 183            |
| <del>Table B.45 – AddCause mapping to OPC Error Code .....</del>                                | <del>166</del> |
| Table B.45 – Cancel service parameter mapping .....                                             | 184            |
| Table B.46 – Cancel negative response mapping to IEM ServiceError .....                         | 184            |
| Table B.47 – Operate service parameter mapping .....                                            | 185            |
| Table B.48 – Operate negative response mapping to IEM ServiceError .....                        | 185            |
| Table B.49 – TimeActivatedOperate service parameter mapping .....                               | 186            |
| Table B.50 – TimeActivatedOperate negative response mapping to IEM ServiceError .....           | 187            |
| Table B.51 – Protocol stack details .....                                                       | 188            |
| <del>Table B.54 – CommandTermination + service parameter mapping .....</del>                    |                |
| <del>Table B.55 – CommandTermination – service parameter mapping .....</del>                    |                |
| Table C.1 – Mapping of IEC 61400-25-3 IEM to ISO 9506 according to IEC 61850-8-1 .....          | 192            |
| <del>Table C.2 – Mapping of AddSubscription service (Step 1) .....</del>                        |                |
| Table C.2 – QueryLogByTime mapping .....                                                        | 195            |
| <del>Table C.3 – Mapping of AddSubscription service (Step 2) .....</del>                        |                |
| Table C.3 – QueryLogAfter mapping .....                                                         | 196            |
| <del>Table C.4 – Mapping of AddSubscription service (Step 3) .....</del>                        |                |
| Table C.4 – Service and protocols for client/server communication A-Profile .....               | 196            |
| <del>Table C.5 – AddSubscription Negative response .....</del>                                  |                |
| Table C.5 – Service and protocols for client/server TCP/IP T-Profile .....                      | 197            |
| <del>Table C.6 – Mapping of RemoveSubscription service – First MMS service .....</del>          |                |
| <del>Table C.7 – Mapping of RemoveSubscription service – second MMS service .....</del>         |                |
| <del>Table C.8 – RemoveSubscription Negative response .....</del>                               |                |
| Table D.1 – Services Mapping overview of IEC 61400-25 IM and IEM .....                          | 200            |
| Table D.2 – Example for mapping of LD and LN to CASDU and IOA .....                             | 203            |
| Table D.3 – Logical device mapping .....                                                        | 203            |
| Table D.4 – Logical node mapping .....                                                          | 204            |
| Table D.5 – CDCs defined in IEC 61400-25-2 .....                                                | 205            |
| Table D.6 – CDC: Status Value, STV class .....                                                  | 205            |
| Table D.7 – CDC: Setpoint Value, SPV class .....                                                | 205            |

|                                                                                                                                      |                |
|--------------------------------------------------------------------------------------------------------------------------------------|----------------|
| Table D.8 – CDC: Alarm, ALM class .....                                                                                              | 206            |
| Table D.9 – CDC: Command CMD class .....                                                                                             | 206            |
| Table D.10 – CDC: Event Counting, CTE class .....                                                                                    | 206            |
| Table D.11 – CDC: State Timing, TMS class .....                                                                                      | 207            |
| Table D.12 – Mapping structure basic CDC .....                                                                                       | 207            |
| Table D.13 – CDC: Controllable Analog set point, APC class .....                                                                     | 209            |
| Table D.14 – CDC: Controllable analogue set point information (APC) mapping of data attributes of the Functional Constraint MX ..... | 209            |
| Table D.15 – CDC: Controllable Analog set point, APC class mapping of data and attributes of the Functional Constraint CO .....      | 210            |
| <del>Table D.16 – Relationship between complex CDCs and IEC 60870-5-104 ASDUs .....</del>                                            | <del>210</del> |
| Table D.16 – CDC: Enumerated status, ENS class .....                                                                                 | 210            |
| Table D.17 – CDC: Enumerated status, ENS class mapping of data and attributes of the Functional Constraint ST .....                  | 211            |
| Table D.18 – CDC: ENC Controllable enumerated status, class ENC .....                                                                | 212            |
| Table D.19 – CDC: Controllable enumerated status, ENC class mapping of data and attributes of the Functional Constraint CO .....     | 212            |
| Table D.20 – CDC: ENG Enumerated status setting, class ENG .....                                                                     | 214            |
| Table D.21 – Relationship between complex CDCs and IEC 60870-5-104 ASDUs .....                                                       | 214            |
| Table D.22 – Mapping of IEC 61400-25 ACSI service into IEC 60870-5-104 services .....                                                | 215            |
| Table E.1 – Services requiring Client/Server Communication Profile .....                                                             | 245            |
| <del>Table E.2 – Quality mapping .....</del>                                                                                         | <del>248</del> |
| Table E.2 – CDC: Setpoint Parameter Value (SPV) mapping .....                                                                        | 248            |
| <del>Table E.3 – CDC: Measured Value (MV) mapping .....</del>                                                                        | <del>250</del> |
| Table E.3 – CDC: Status Value (STV) mapping .....                                                                                    | 250            |
| Table E.4 – CDC: Alarm (ALM) mapping .....                                                                                           | 251            |
| Table E.5 – CDC: Command (CMD) mapping .....                                                                                         | 253            |
| Table E.6 – CDC: Event Counting (CTE) mapping .....                                                                                  | 254            |
| Table E.7 – CDC: State Timing (TMS) mapping .....                                                                                    | 256            |
| Table E.8 – CDC: Device Name Plate (WDPL) mapping .....                                                                              | 259            |
| Table E.9 – CDC: Alarm Set Status ( <del>ASS</del> AST) mapping .....                                                                | 260            |
| <del>Table E.10 – CDC: Single Point Status (SPS) mapping .....</del>                                                                 | <del>260</del> |
| <del>Table E.11 – CDC: Integer Status (INS) mapping .....</del>                                                                      | <del>260</del> |
| <del>Table E.12 – CDC: Controllable single point (SPC) mapping .....</del>                                                           | <del>260</del> |
| <del>Table E.13 – CDC: Controllable integer status (INC) mapping .....</del>                                                         | <del>260</del> |
| <del>Table E.14 – CDC: Binary Counter Reading (BCR) mapping .....</del>                                                              | <del>260</del> |
| <del>Table E.15 – CDC: Controllable analogue set point (APC) mapping .....</del>                                                     | <del>260</del> |
| <del>Table E.16 – CDC: Phase to ground (WYE) mapping .....</del>                                                                     | <del>260</del> |
| <del>Table E.17 – CDC: Phase to phase (DEL) mapping .....</del>                                                                      | <del>260</del> |
| <del>Table E.18 – CDC: Device Name Plate (WDPL) mapping .....</del>                                                                  | <del>260</del> |
| <del>Table E.19 – CDC: Logical Node Name Plate (LPL) mapping .....</del>                                                             | <del>260</del> |
| <del>Table E.20 – CDC: Alarm Set Status (ASS) mapping .....</del>                                                                    | <del>260</del> |
| <del>Table E.21 – Sample Data Class Attribute mapping .....</del>                                                                    | <del>260</del> |
| <del>Table E.22 – Sample Data Class mapping .....</del>                                                                              | <del>260</del> |

~~Table E.23 — Sample partial Data Class mapping~~

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**WIND ~~TURBINES~~ ENERGY GENERATION SYSTEMS –****Part 25-4: Communications for monitoring  
and control of wind power plants –  
Mapping to communication profile**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

**This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.**

International Standard IEC 61400-25-4 has been prepared by IEC technical committee 88: Wind energy generation systems.

This second edition cancels and replaces the first edition published in 2008. This edition constitutes a technical revision.

The main technical changes with regard to the previous edition are as follows:

General harmonization with information models in IEC 61400-25-2 and information exchange services in IEC 61400-25-3.

Reduction of overlap between standards and simplification by increased referencing.

For Annex A Webservices: Changes are limited to harmonization with IEC 61850 and with other parts of IEC 61400-25. Updating of webservices to use soap over websockets have been considered.

Maintenance of Annex B OPC/XML-DA included an evaluation of the use of custom item properties. OPC UA was not chosen as basis for IEC 61850-8-2, however the work of TS 61400-25-41 is currently considering if OPC UA can replace the existing OPC/XML-DA mapping in future editions of IEC 61400-25-4. A mapping to OPC UA is thus not part of this second edition of IEC 61400-25-4, but could be submitted as a separate document.

The mapping to IEC 61850-8-1 in Annex C is harmonized with the latest edition of IEC 61850-8-1.

The mapping to IEC 60870-5-104 in Annex D includes further harmonization with IEC 61850-80-1.

Finally, Annex E DNP3 is harmonized with the latest version of IEEE 1815-1. This includes an adaptation to support wind power specific models.

- a) Mapping of AddSubscription and RemoveSubscription services have been removed, to be in line with IEC 61400-25-3.
- b) Tables indicating services supported have been replaced by tables in accordance with IEC 61400-25-3:2015 Annex D including ACSI conformance statements for clients and servers, individually.
- c) Technical issues (Tissues) for IEC 61850-7-2:2010 have been considered and changes have been made accordingly
- d) Technical issues (Tissues), as collected by the IEC 61400-25 users group USE61400-25, have been considered, and changes have been made accordingly.
- e) The changes made to Annex A includes the following: Mapping to object classes has been removed for objects (Server, LD, LN, Data Set, RCB, UCB, LCB and Log) not used in the services. Object names are defined as names of complex types instead of elements. Faulty references have been removed. WSDL tags have been renamed for better alignment and consistency. Values for maximum message size are specified. Mapping to service GetAllDataValues have been added. Examples have been introduced for typical service requests and responses. A new version of the WSDL has been created, validated with XmlSpy.
- f) The changes to Annex B OPC/XML-DA have been made in accordance with the scope of the revision. Main focus has been on the mapping of the Array type, of the GetAllDataValues service, of the report model and the control services.
- g) The technical change made to Annex C is an adaptation of TCP/IP Profile services according to the changes in IEC 61850-8-1:2011 (Communication and link redundancy added).

- h) The most important change in Annex D is the synchronization with the second edition of referenced IEC 61850 standards. In accordance with the work on IEC 61850-80-1 Edition 2 the new CDCs are mapped to IEC 60870-5-104. Also an interoperability list for the IEC 61400-25-4 Mapping IEC 60870-5-104 has been created, as a subset of the interoperability list of IEC 61850-80-1.
- i) Annex E (DNP3) has been updated to use the same approach as IEEE 1815.1. It describes how to translate the IEC 61400-25-2 common data class attributes to DNP3 points. The use of DNP3 datasets described in IEC 61400-25-4:2008 has been removed, as it did not offer a flexible approach to map the IEC 61400-25-2 information.

The text of this standard is based on the following documents:

| FDIS        | Report on voting |
|-------------|------------------|
| 88/600/FDIS | 88/607/RVD       |

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61400 series, published under the general title *Wind energy generation systems*, can be found on the IEC website.

For the user's convenience, a file containing the text of Clause A.7 is included with this document.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## INTRODUCTION

The IEC 61400-25 series defines communications for monitoring and control of wind power plants. The architecture of the IEC 61400-25 series has been selected to provide an abstract definition of classes and services such that the specifications are independent of specific protocol stacks, implementations, and operating systems. This part of IEC 61400-25 specifies the mapping of these abstract classes and services to protocol stacks.

NOTE Performance of the IEC 61400-25 series implementations are application-specific. The IEC 61400-25 series does not guarantee a certain level of performance. This is beyond the scope of the IEC 61400-25 series. However, there is no underlying limitation in the communications technology to prevent high-speed application (millisecond level responses).

## WIND ~~TURBINES~~ ENERGY GENERATION SYSTEMS –

### **Part 25-4: Communications for monitoring and control of wind power plants – Mapping to communication profile**

#### **1 Scope**

The focus of the IEC 61400-25 series is on the communications between wind power plant components such as wind turbines and actors such as SCADA systems. Internal communication within wind power plant components is outside the scope of the IEC 61400-25 series.

The IEC 61400-25 series is designed for a communication environment supported by a client-server model. Three areas are defined, that are modelled separately to ensure the scalability of implementations:

- a) wind power plant information model,
- b) information exchange model, and
- c) mapping of these two models to a standard communication profile.

The wind power plant information model and the information exchange model, viewed together, constitute an interface between client and server. In this conjunction, the wind power plant information model serves as an interpretation frame for available wind power plant information. The wind power plant information model is used by the server to offer the client a uniform, component-oriented view of the wind power plant data. The information exchange model reflects the whole active functionality of the server. The IEC 61400-25 series enables connectivity between a heterogeneous combination of client and servers from different manufacturers and suppliers.

As depicted in Figure 1, the IEC 61400-25 series defines a server with the following aspects:

- Information provided by a wind power plant component, for example, ‘wind turbine rotor speed’ or ‘total power production of a certain time interval’ is modelled and made available for access. The information modelled in the IEC 61400-25 series is defined in IEC 61400-25-2.
- Services to exchange values of the modelled information, defined in IEC 61400-25-3.
- Mapping to a communication profile, providing a protocol stack to carry the messages, i.e. the service requests and responses and the values from the modelled information (IEC 61400-25-4).

IEC 61400-25-5 defines test cases associated with information, services and protocol stacks for conformance testing of both servers and clients.

The IEC 61400-25 series only defines how to model the information, information exchange and mapping to specific communication protocols. The IEC 61400-25 series excludes a definition of how and where to implement the communication interface, the application program interface and implementation recommendations. However, the objective of the IEC 61400-25 series is that the information associated with a single wind power plant component (such as a wind turbine) is accessible through a corresponding logical device.


This part of the IEC 61400-25 series specifies the specific mappings to protocol stacks encoding the messages required for the information exchange between a client and a remote server for:

- data access and retrieval,
- device control,
- event reporting and logging,
- publisher/subscriber,
- self-description of devices (device data dictionary),
- data typing and discovery of data types.

The mappings specified in this part of IEC 61400-25 comprise:

- a mapping to SOAP-based web services,
- a mapping to OPC/XML-DA,
- a mapping to IEC 61850-8-1 MMS,
- a mapping to IEC 60870-5-104,
- a mapping to DNP3.

All mappings are optional, but at least one optional mapping ~~shall~~ needs to be selected in order to be compliant with this part of IEC 61400-25.

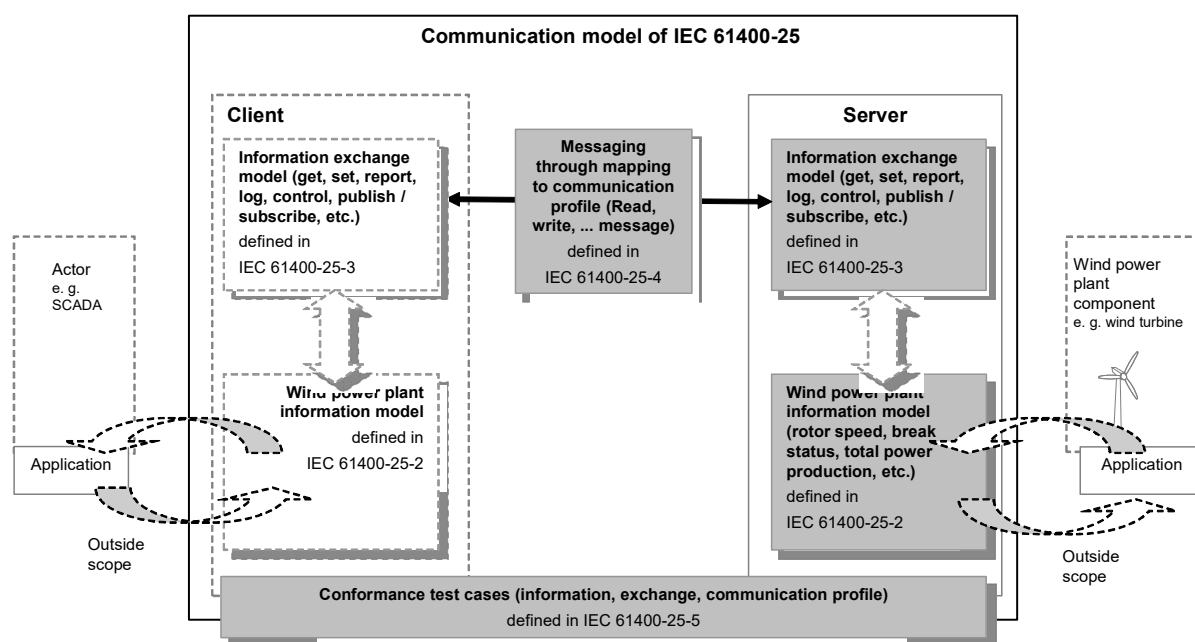

IEC

**Figure 1 – Conceptual communication model of IEC 61400-25 series**

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60870-5-4:1993, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 4: Definition and coding of application information elements*

IEC 60870-5-5:1995, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 5: Basic application functions*

IEC 60870-5-101:2003, *Telecontrol equipment and systems – Part 5-101: Transmission protocols – Companion standard for basic telecontrol tasks*

IEC 60870-5-104:2006, *Telecontrol equipment and systems – Part 5-104: Transmission protocols – Network access for IEC 60870-5-101 using standard transport profiles*

~~IEC 61400-25 (all parts), Wind turbines – Part 25: Communications for monitoring and control of wind power plants~~

IEC 61400-25-1:2006, *Wind turbines – Part 25-1: Communications for monitoring and control of wind power plants – Overall description of principles and models*

IEC 61400-25-2:2015, *Wind turbines – Part 25-2: Communications for monitoring and control of wind power plants – Information models*

IEC 61400-25-3:2015, *Wind turbines – Part 25-3: Communications for monitoring and control of wind power plants – Information exchange models*

IEC 61400-25-5:2006, *Wind turbines – Part 25-5: Communications for monitoring and control of wind power plants – Conformance testing*

IEC 61850-6:2009, *Communication networks and systems for power utility automation – Part 6: Configuration description language for communication in electrical substations related to IEDs*

IEC 61850-7-2: ~~2003~~ 2010, *Communication networks and systems ~~in substations~~ for power utility automation – Part 7-2: Basic ~~information and~~ communication structure ~~for substations and feeder equipment~~* – Abstract communication service interface (ACSI)

IEC 61850-7-3: ~~2003~~ 2010, *Communication networks and systems ~~in substations~~ for power utility automation – Part 7-3: Basic communication structure ~~for substations and feeder equipment~~* – Common data classes

IEC 61850-8-1: ~~2004~~ 2011, *Communication networks and systems ~~in substations~~ for power utility automation – Part 8-1: Specific Communication Service Mapping (SCSM) – Mappings to MMS (ISO 9506-1 and ISO 9506-2) and to ISO/IEC 8802-3*

~~DNP3 Specification, Volume 2 – Volume 8:2007~~

IEC TS 61850-80-1:2008, *Communication networks and systems for power utility automation – Part 80-1: Guideline to exchanging information from a CDC-based data model using IEC 60870-5-101 or IEC 60870-5-104*

IEC 62439-3:2016, *Industrial communication networks – High availability automation networks – Part 3: Parallel Redundancy Protocol (PRP) and High-availability Seamless Redundancy (HSR)*

ISO 639-2, *Codes for the representation of names of languages – Part 2: Alpha-3 code*

ISO/IEC 8326:1996, *Information technology – Open Systems Interconnection – Session service definition*

ISO/IEC 8327-1:1996, *Information technology – Open Systems Interconnection – Connection-oriented Session protocol: Protocol specification*

ISO/IEC 8649:1996, *Information technology – Open Systems Interconnection – Service definition for the Association Control Service Element*

ISO/IEC 8650-1:1996, *Information technology – Open Systems Interconnection – Connection-oriented protocol for the Association Control Service Element: Protocol specification*

ISO/IEC 8822:1994, *Information technology – Open Systems Interconnection – Presentation service definition*

ISO/IEC 8823-1:1994, *Information technology – Open Systems Interconnection – Connection-oriented presentation protocol: Protocol specification*

ISO/IEC 8824-1:2015, *Information technology – Abstract Syntax Notation One (ASN.1): Specification of basic notation*

ISO/IEC 8825-1:2015, *Information technology – ASN.1 encoding rules: Specification of Basic Encoding Rules (BER), Canonical Encoding Rules (CER) and Distinguished Encoding Rules (DER)*

ISO 9506-1:2003, *Industrial automation systems – Manufacturing Message Specification – Part 1: Service definition*

ISO 9506-2:2003, *Industrial automation systems – Manufacturing Message Specification – Part 2: Protocol specification*

W3C, *Web Services Architecture*, <http://www.w3.org/TR/2002/WD-ws-arch-20021114/>

W3C, *Extensible Markup Language (XML) 1.0*, <http://www.w3.org/TR/2000/REC-xml-20001006>

SOAP ver. 1.1, W3C Note *Simple Object Access Protocol (SOAP) 1.1*, 8 May 2000. <http://www.w3.org/TR/2006/NOTE-soap11-ror-httpbinding-20060321/#reqoptrespbinding> and <http://www.w3.org/TR/2000/NOTE-SOAP-20000508/>  
(Referenced in Annex B)

SOAP ver. 1.2, W3C, 27. April 2007: <http://www.w3.org/TR/soap>  
(Referenced in Annex A)

RFC 791, *Internet Protocol specification (IP)*

RFC 792, *Internet Control Message Protocol (ICMP)*

RFC 793, *Transmission Control Protocol (TCP)*

RFC 826, *Ethernet Address Resolution Protocol*

RFC 919, *Broadcasting internet datagrams*

RFC 922, *Broadcasting internet datagrams in presence of subnets*

RFC 950, *Internet Standard Subnetting Procedure*

RFC 1006, *ISO Transport Service on top of the TCP Version: 3*

RFC 1112, *Host Extensions for IP Multicasting*

RFC 1122, *Requirements for Internet Hosts – Communication Layers, IETF*

RFC 2200, *Internet Official Protocol Standards, Request for Comments 2200, June 1997*

RFC 2616, *Hypertext Transfer Protocol – HTTP/1.1*

RFC 2817, *Upgrading to TLS Within HTTP/1.1*

RFC 4122, *Universally Unique Identifier (UUID) URN Namespace*

RFC 5246, *Transport Layer Security (TLS version 1.2) protocol*

OPC XML-DA Specification. Version1.01, 18 December 2004

IEEE Std 754:1985, *IEEE Standard for Binary Floating-Point Arithmetic*

IEEE 802.1D:2004, *IEEE Standard for Local and Metropolitan Area Networks: Media access control (MAC) Bridges*

IEEE P1815.1:2015, *Standard for exchanging Information between networks implementing IEC 61850 and IEEE Std 1815 (Distributed Network Protocol – DNP3)*

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE



**Wind energy generation systems –  
Part 25-4: Communications for monitoring and control of wind power plants –  
Mapping to communication profile**

**Systèmes de génération d'énergie éolienne –  
Partie 25-4: Communications pour la surveillance et la commande des centrales  
éoliennes – Mapping pour les profils de communication**

## CONTENTS

|                                                                                                           |     |
|-----------------------------------------------------------------------------------------------------------|-----|
| FOREWORD.....                                                                                             | 10  |
| INTRODUCTION.....                                                                                         | 13  |
| 1 Scope.....                                                                                              | 14  |
| 2 Normative references .....                                                                              | 15  |
| 3 Terms and definitions .....                                                                             | 18  |
| 4 Abbreviated terms .....                                                                                 | 18  |
| 5 General overview.....                                                                                   | 19  |
| 5.1 General.....                                                                                          | 19  |
| 5.2 Mapping to protocol stacks .....                                                                      | 20  |
| 5.3 Services of IEC 61400-25-3 mapped to protocol stacks.....                                             | 20  |
| Annex A (normative) Specific communication service mapping – Definition and mapping to Web Services ..... | 23  |
| A.1 General.....                                                                                          | 23  |
| A.1.1 Introduction to definition and mapping to Web Services .....                                        | 23  |
| A.1.2 Scope of the definition and mapping to Web Services .....                                           | 23  |
| A.1.3 The mapping architecture .....                                                                      | 23  |
| A.2 Mapping of the IEC 61400-25 Information Model to Web Services .....                                   | 26  |
| A.2.1 General introduction to mapping to web services .....                                               | 26  |
| A.2.2 DATA OBJECT class .....                                                                             | 29  |
| A.2.3 DATA ATTRIBUTE definition .....                                                                     | 29  |
| A.3 Mapping of the Information Exchange Model to Web Services .....                                       | 30  |
| A.3.1 General .....                                                                                       | 30  |
| A.3.2 SERVER class service mapping .....                                                                  | 30  |
| A.3.3 LOGICAL-DEVICE class service mapping.....                                                           | 36  |
| A.3.4 LOGICAL-NODE class services mapping.....                                                            | 38  |
| A.3.5 DATA class services mapping.....                                                                    | 41  |
| A.3.6 DATA-SET class services mapping.....                                                                | 51  |
| A.3.7 REPORT-CONTROL-BLOCK (RCB) class services mapping .....                                             | 58  |
| A.3.8 LOG-CONTROL-BLOCK (LCB) class services mapping .....                                                | 73  |
| A.3.9 LOG class services mapping.....                                                                     | 77  |
| A.3.10 CONTROL class services mapping .....                                                               | 81  |
| A.4 Protocol stack details.....                                                                           | 94  |
| A.5 The WSDL specification for the definition and mapping to Web Services .....                           | 95  |
| Annex B (normative) Specific communication service mapping – Mapping to OPC XML-DA.....                   | 129 |
| B.1 General.....                                                                                          | 129 |
| B.1.1 Introduction to mapping to OPC XML-DA .....                                                         | 129 |
| B.1.2 Scope for the mapping to OPC XML-DA.....                                                            | 129 |
| B.1.3 The mapping architecture .....                                                                      | 129 |
| B.2 Mapping of the IEC 61400-25 Information Model to OPC XML-DA.....                                      | 132 |
| B.2.1 Mapping of IEC 61400-25-2 Information Model classes to OPC XML-DA .....                             | 132 |
| B.2.2 Server .....                                                                                        | 132 |
| B.2.3 Logical Device .....                                                                                | 133 |
| B.2.4 Logical Node .....                                                                                  | 133 |
| B.2.5 Data Object .....                                                                                   | 133 |
| B.2.6 Data Attribute .....                                                                                | 134 |

|                                                                                                                              |                                                                                                                         |     |
|------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------|-----|
| B.3                                                                                                                          | Mapping of the Information Exchange Model to OPC XML-DA services .....                                                  | 140 |
| B.3.1                                                                                                                        | General .....                                                                                                           | 140 |
| B.3.2                                                                                                                        | Association model .....                                                                                                 | 140 |
| B.3.3                                                                                                                        | Server class services – GetServerDirectory .....                                                                        | 143 |
| B.3.4                                                                                                                        | Logical device class services – GetLogicalDeviceDirectory .....                                                         | 145 |
| B.3.5                                                                                                                        | Logical node class services .....                                                                                       | 147 |
| B.3.6                                                                                                                        | Data class services .....                                                                                               | 149 |
| B.3.7                                                                                                                        | Data set model .....                                                                                                    | 156 |
| B.3.8                                                                                                                        | Report model .....                                                                                                      | 160 |
| B.3.9                                                                                                                        | Control model .....                                                                                                     | 164 |
| B.4                                                                                                                          | Protocol stack details .....                                                                                            | 174 |
| Annex C (normative) Specific communication service mapping – Mapping to ISO 9506 specified in IEC 61850-8-1 .....            |                                                                                                                         | 176 |
| C.1                                                                                                                          | General .....                                                                                                           | 176 |
| C.1.1                                                                                                                        | Introduction to mapping to ISO 9506 specified in IEC 61850-8-1 .....                                                    | 176 |
| C.1.2                                                                                                                        | Scope of the mapping to ISO 9506 specified in IEC 61850-8-1 .....                                                       | 176 |
| C.1.3                                                                                                                        | The mapping architecture .....                                                                                          | 176 |
| C.2                                                                                                                          | Mapping of the IEC 61400-25 Information Model to ISO 9506 as specified in IEC 61850-8-1 .....                           | 178 |
| C.2.1                                                                                                                        | General .....                                                                                                           | 178 |
| C.2.2                                                                                                                        | Extended Logging services .....                                                                                         | 179 |
| C.3                                                                                                                          | Protocol stack details .....                                                                                            | 179 |
| C.3.1                                                                                                                        | General .....                                                                                                           | 179 |
| C.3.2                                                                                                                        | A-Profile .....                                                                                                         | 179 |
| C.3.3                                                                                                                        | TCP/IP T-Profile .....                                                                                                  | 180 |
| Annex D (normative) Specific communication service mapping – Mapping to IEC 60870-5-104 specified in IEC TS 61850-80-1 ..... |                                                                                                                         | 182 |
| D.1                                                                                                                          | General .....                                                                                                           | 182 |
| D.1.1                                                                                                                        | Introduction to mapping to IEC 60870-5-104 specified in IEC TS 61850-80-1 .....                                         | 182 |
| D.1.2                                                                                                                        | Scope of the mapping to IEC 60870-5-104 specified in IEC TS 61850-80-1 .....                                            | 182 |
| D.1.3                                                                                                                        | The mapping architecture .....                                                                                          | 182 |
| D.2                                                                                                                          | Mapping of the IEC 61400-25 Information Model to IEC 60870-5-104 as specified in IEC TS 61850-80-1 .....                | 185 |
| D.2.1                                                                                                                        | General .....                                                                                                           | 185 |
| D.2.2                                                                                                                        | Logical Device IM class mapping .....                                                                                   | 186 |
| D.2.3                                                                                                                        | Logical Node IM class mapping .....                                                                                     | 187 |
| D.3                                                                                                                          | Mapping of IEC 61400-25 Information Model data to IEC 60870-5-104 .....                                                 | 187 |
| D.3.1                                                                                                                        | Mapping of the Common Data Classes (CDC) .....                                                                          | 187 |
| D.4                                                                                                                          | Mapping of the Information Exchange Model to IEC 60870-5-104 services .....                                             | 198 |
| D.4.1                                                                                                                        | List of service models and corresponding mappings .....                                                                 | 198 |
| D.4.2                                                                                                                        | Control class mapping .....                                                                                             | 199 |
| D.5                                                                                                                          | Protocol stack selections for IEC 60870-5-104 (Protocol stack details) .....                                            | 211 |
| D.5.1                                                                                                                        | General .....                                                                                                           | 211 |
| D.5.2                                                                                                                        | Structure of application data .....                                                                                     | 211 |
| D.5.3                                                                                                                        | IEC 60870-5-104 Interoperability .....                                                                                  | 211 |
| D.6                                                                                                                          | Use of SCL (Substation Configuration Language) extension to include IEC 60870-5-101/104 information (informative) ..... | 224 |
| D.6.1                                                                                                                        | General .....                                                                                                           | 224 |

|                                                                                              |                                                                       |     |
|----------------------------------------------------------------------------------------------|-----------------------------------------------------------------------|-----|
| D.6.2                                                                                        | SCL information model hierarchy .....                                 | 224 |
| D.6.3                                                                                        | IEC 60870-5-101/104 Private section syntax.....                       | 224 |
| D.6.4                                                                                        | IEC 60870-5-104 communication parameters configuration using SCL..... | 224 |
| Annex E (normative)                                                                          | Specific communication service mapping – Mapping to DNP3 .....        | 225 |
| E.1                                                                                          | General.....                                                          | 225 |
| E.1.1                                                                                        | Introduction to mapping to DNP3 .....                                 | 225 |
| E.1.2                                                                                        | Scope for the mapping to DNP3.....                                    | 225 |
| E.1.3                                                                                        | Mapping architecture .....                                            | 225 |
| E.2                                                                                          | Mapping of the IEC 61400-25 Information Model to DNP3.....            | 228 |
| E.2.1                                                                                        | Mapping of IEC 61850-7-3 inherited common Data Classes .....          | 228 |
| E.2.2                                                                                        | CDC Setpoint Parameter Value (SPV) .....                              | 228 |
| E.2.3                                                                                        | CDC Status Value (STV).....                                           | 229 |
| E.2.4                                                                                        | CDC Alarm (ALM) .....                                                 | 230 |
| E.2.5                                                                                        | CDC Command (CMD).....                                                | 232 |
| E.2.6                                                                                        | CDC Event Counting (CTE) .....                                        | 232 |
| E.2.7                                                                                        | CDC State Timing (TMS) .....                                          | 233 |
| E.2.8                                                                                        | CDC Device Name Plate (WDPL).....                                     | 234 |
| E.2.9                                                                                        | CDC Alarm Set Status (AST) .....                                      | 235 |
| E.3                                                                                          | Mapping of the Information Exchange Model to DNP3 services .....      | 236 |
| Annex F (normative)                                                                          | Time synchronization .....                                            | 237 |
| F.1                                                                                          | General.....                                                          | 237 |
| F.2                                                                                          | A-Profile .....                                                       | 237 |
| F.3                                                                                          | T-Profile.....                                                        | 237 |
| Annex G (informative)                                                                        | Interfaces – Implementation considerations .....                      | 238 |
| G.1                                                                                          | General.....                                                          | 238 |
| G.2                                                                                          | Example interfaces of a real system.....                              | 238 |
| Bibliography                                                                                 | .....                                                                 | 240 |
| Figure 1 – Conceptual communication model of IEC 61400-25 series .....                       |                                                                       | 15  |
| Figure 2 – Communication profiles .....                                                      |                                                                       | 20  |
| Figure A.1 – Mapping architecture (conceptual) .....                                         |                                                                       | 24  |
| Figure A.2 – Naming structure applied in the IEC 61400-25 series (conceptual).....           |                                                                       | 27  |
| Figure A.3 – Client behavior in the reporting service (conceptual).....                      |                                                                       | 59  |
| Figure A.4 – Server behavior in the reporting service (conceptual).....                      |                                                                       | 60  |
| Figure A.5 – Reporting Services mechanism (conceptual).....                                  |                                                                       | 61  |
| Figure B.1 – Mapping architecture (conceptual) .....                                         |                                                                       | 130 |
| Figure B.2 – Differences between OPC XML-DA and IEC Information Model timestamp.....         |                                                                       | 137 |
| Figure B.3 – Sequence of services to establish an association.....                           |                                                                       | 142 |
| Figure B.4 – CreateDataSet sequence of services .....                                        |                                                                       | 158 |
| Figure C.1 – Mapping architecture (conceptual) .....                                         |                                                                       | 177 |
| Figure D.1 – Mapping architecture (conceptual) .....                                         |                                                                       | 183 |
| Figure D.2 – Direct Control with Normal Security with status update – positive case .....    |                                                                       | 200 |
| Figure D.3 – Direct Control with Normal Security in general – negative case a) .....         |                                                                       | 201 |
| Figure D.4 – Direct Control with Normal Security in general – negative case b) .....         |                                                                       | 201 |
| Figure D.5 – Direct Control with Normal Security with status update – negative case c).....  |                                                                       | 202 |
| Figure D.6 – Direct Control with Normal Security without status update – positive case ..... |                                                                       | 203 |

|                                                                             |     |
|-----------------------------------------------------------------------------|-----|
| Figure D.7 – Direct Control with Enhanced Security – positive case .....    | 204 |
| Figure D.8 – Direct Control with Enhanced Security – negative case c).....  | 205 |
| Figure D.9 – Direct Control with Enhanced Security – negative case d) ..... | 206 |
| Figure D.10 – SBOw control – positive case .....                            | 207 |
| Figure D.11 – SBOw control – negative case a) .....                         | 207 |
| Figure D.12 – SBOw control – negative case b) .....                         | 208 |
| Figure D.13 – SBOw control – negative case c) .....                         | 209 |
| Figure D.14 – SBO with Enhanced Security – positive case .....              | 209 |
| Figure D.15 – SBO with Enhanced Security – negative case a).....            | 210 |
| Figure D.16 – SBO with Enhanced Security – negative case b).....            | 211 |
| Figure E.1 – Mapping architecture (conceptual) .....                        | 226 |
| Figure G.1 – Implementation issues (example) .....                          | 239 |
| <br>                                                                        |     |
| Table 1 – Mapping overview of IEC 61400-25-3 services .....                 | 22  |
| Table A.1 – Web Services mapping overview of IEC 61400-25 IM and IEM.....   | 25  |
| Table A.2 – Mapping the IEC 61400-25 IM to Web Services.....                | 26  |
| Table A.3 – XML schema for wind power information model.....                | 29  |
| Table A.4 – Server class services mapped to Web Services .....              | 30  |
| Table A.5 – GetServerDirectoryRequest .....                                 | 31  |
| Table A.6 – GetServerDirectoryResponse .....                                | 31  |
| Table A.7 – AssociateRequest .....                                          | 33  |
| Table A.8 – AssociateResponse .....                                         | 34  |
| Table A.9 – ReleaseRequest.....                                             | 35  |
| Table A.10 – ReleaseResponse .....                                          | 35  |
| Table A.11 – AbortRequest .....                                             | 36  |
| Table A.12 – AbortResponse .....                                            | 36  |
| Table A.13 – LOGICAL-DEVICE service mapping .....                           | 37  |
| Table A.14 – GetLogicalDeviceDirectoryRequest .....                         | 37  |
| Table A.15 – GetLogicalDeviceDirectoryResponse .....                        | 38  |
| Table A.16 – LOGICAL-NODE mapping .....                                     | 38  |
| Table A.17 – GetLogicalNodeDirectoryRequest .....                           | 39  |
| Table A.18 – GetLogicalNodeDirectoryResponse .....                          | 39  |
| Table A.19 – GetAllDataValuesRequest .....                                  | 40  |
| Table A.20 – GetAllDataValuesResponse .....                                 | 41  |
| Table A.21 – Data mapping.....                                              | 41  |
| Table A.22 – GetDataValuesRequest.....                                      | 42  |
| Table A.23 – GetDataValuesResponse .....                                    | 42  |
| Table A.24 – SetDataValuesRequest .....                                     | 45  |
| Table A.25 – SetDataValuesResponse.....                                     | 46  |
| Table A.26 – GetDataDirectoryRequest .....                                  | 46  |
| Table A.27 – GetDataDirectoryResponse .....                                 | 47  |
| Table A.28 – GetDataDefinitionRequest.....                                  | 48  |
| Table A.29 – GetDataDefinitionResponse .....                                | 49  |

|                                                          |    |
|----------------------------------------------------------|----|
| Table A.30 – DATA-SET mapping .....                      | 51 |
| Table A.31 – GetDataSetValuesRequest.....                | 52 |
| Table A.32 – GetDataSetValuesResponse .....              | 52 |
| Table A.33 – SetDataSetValuesRequest .....               | 54 |
| Table A.34 – SetDataSetValuesResponse .....              | 54 |
| Table A.35 – CreateDataSetRequest .....                  | 55 |
| Table A.36 – CreateDataSetResponse .....                 | 56 |
| Table A.37 – DeleteDataSetRequest.....                   | 56 |
| Table A.38 – DeleteDataSetResponse .....                 | 57 |
| Table A.39 – GetDataSetDirectoryRequest .....            | 57 |
| Table A.40 – GetDataSetDirectoryResponse.....            | 58 |
| Table A.41 – Report control block services mapping ..... | 58 |
| Table A.42 – ReportFormat.....                           | 62 |
| Table A.43 – GetBRCBValuesRequest.....                   | 63 |
| Table A.44 – GetBRCBValuesResponse .....                 | 64 |
| Table A.45 – SetBRCBValuesRequest .....                  | 66 |
| Table A.46 – SetBRCBValuesResponse .....                 | 67 |
| Table A.47 – GetURCBValuesRequest.....                   | 68 |
| Table A.48 – GetURCBValuesResponse .....                 | 68 |
| Table A.49 – SetURCBValuesRequest.....                   | 70 |
| Table A.50 – SetURCBValuesResponse .....                 | 71 |
| Table A.51 – ReportRequest.....                          | 72 |
| Table A.52 – ReportResponse .....                        | 73 |
| Table A.53 – LOG-CONTROL-BLOCK services mapping .....    | 73 |
| Table A.54 – GetLCBValuesRequest.....                    | 74 |
| Table A.55 – GetLCBValuesResponse .....                  | 75 |
| Table A.56 – SetLCBValuesRequest.....                    | 76 |
| Table A.57 – SetLCBValuesResponse .....                  | 76 |
| Table A.58 – Log class services mapping .....            | 77 |
| Table A.59 – GetLogStatusValuesRequest.....              | 77 |
| Table A.60 – GetLogStatusValuesResponse .....            | 78 |
| Table A.61 – QueryLogByTimeRequest.....                  | 79 |
| Table A.62 – QueryLogByTimeResponse .....                | 80 |
| Table A.63 – QueryLogAfterRequest.....                   | 80 |
| Table A.64 – QueryLogAfterResponse .....                 | 81 |
| Table A.65 – Control class services mapping.....         | 82 |
| Table A.66 – SelectRequest.....                          | 82 |
| Table A.67 – SelectResponse .....                        | 83 |
| Table A.68 – SelectWithValueRequest.....                 | 84 |
| Table A.69 – SelectWithValueResponse .....               | 85 |
| Table A.70 – CancelRequest.....                          | 86 |
| Table A.71 – CancelResponse .....                        | 87 |
| Table A.72 – OperateRequest.....                         | 88 |

|                                                                                               |     |
|-----------------------------------------------------------------------------------------------|-----|
| Table A.73 – OperateResponse .....                                                            | 89  |
| Table A.74 – CommandTerminationRequest .....                                                  | 90  |
| Table A.75 – CommandTerminationResponse.....                                                  | 90  |
| Table A.76 – TimeActivatedOperateRequest.....                                                 | 91  |
| Table A.77 – TimeActivatedOperateResponse .....                                               | 92  |
| Table A.78 – TimeActivatedOperateTerminationRequest .....                                     | 93  |
| Table A.79 – TimeActivatedOperateTerminationResponse .....                                    | 93  |
| Table A.80 – AddCause parameter response .....                                                | 94  |
| Table A.81 – Protocol stack selections.....                                                   | 95  |
| Table B.1 – Mapping of IEC 61400-25-3 IEM service into OPC XML-DA services .....              | 131 |
| Table B.2 – Mapping of IEC 61400-25-2 IM classes to OPC XML-DA.....                           | 132 |
| Table B.3 – Server class attributes .....                                                     | 132 |
| Table B.4 – Logical Device Class attributes .....                                             | 133 |
| Table B.5 – Logical Node Class attributes.....                                                | 133 |
| Table B.6 – Data Object Class attributes .....                                                | 134 |
| Table B.7 – Data Attribute Class attributes .....                                             | 134 |
| Table B.8 – Mapping of the Basic Types .....                                                  | 135 |
| Table B.9 – New OPC XML-DA Error codes .....                                                  | 137 |
| Table B.10 – Timestamp mapping .....                                                          | 138 |
| Table B.11 – Mapping of the Quality attribute .....                                           | 138 |
| Table B.12 – Cookie parameter explanation.....                                                | 141 |
| Table B.13 – IEM GetServerDirectory mapping .....                                             | 143 |
| Table B.14 – IEM GetServerDirectory mapping detailed.....                                     | 144 |
| Table B.15 – IEM GetLogicalDeviceDirectory mapping.....                                       | 145 |
| Table B.16 – IEM GetLogicalDeviceDirectory mapping detailed .....                             | 145 |
| Table B.17 – GetLogicalDeviceDirectory negative response mapping to IEM<br>ServiceError ..... | 146 |
| Table B.18 – IEM GetLogicalNodeDirectory mapping .....                                        | 147 |
| Table B.19 – IEM GetLogicalNodeDirectory mapping detailed .....                               | 147 |
| Table B.20 – GetLogicalNodeDirectory negative response mapping to IEM<br>ServiceError .....   | 148 |
| Table B.21 – IEM GetDataValues mapping .....                                                  | 149 |
| Table B.22 – IEM GetDataValues mapping detailed .....                                         | 150 |
| Table B.23 – GetDataValues negative response mapping to IEM ServiceError.....                 | 151 |
| Table B.24 – IEM SetDataValues mapping.....                                                   | 152 |
| Table B.25 – IEM SetDataValues mapping detailed .....                                         | 152 |
| Table B.26 – SetDataValues negative response mapping to IEM ServiceError .....                | 154 |
| Table B.27 – IEM GetDataDirectory mapping .....                                               | 154 |
| Table B.28 – IEM GetDataDirectory mapping detailed.....                                       | 155 |
| Table B.29 – GetDataDirectory negative response mapping to IEM ServiceError .....             | 156 |
| Table B.30 – Mapping of CreateDataSet service parameters .....                                | 158 |
| Table B.31 – CreateDataSet negative response mapping to IEM ServiceError .....                | 158 |
| Table B.32 – GetDataSetValues negative response mapping to IEM ServiceError .....             | 159 |
| Table B.33 – SetDataSetValues negative response mapping to IEM ServiceError.....              | 159 |

|                                                                                                                                      |     |
|--------------------------------------------------------------------------------------------------------------------------------------|-----|
| Table B.34 – OPC Subscription attributes' constrained value .....                                                                    | 160 |
| Table B.35 – Subscribe .....                                                                                                         | 161 |
| Table B.36 – Subscription Cancel .....                                                                                               | 163 |
| Table B.37 – Fault mapping to IEM ServiceError .....                                                                                 | 163 |
| Table B.38 – Mapping of Report service parameters .....                                                                              | 163 |
| Table B.39 – Control models supported in this mapping .....                                                                          | 164 |
| Table B.40 – Control services supported .....                                                                                        | 164 |
| Table B.41 – Control model writable custom item properties .....                                                                     | 166 |
| Table B.42 – AddCause mapping to OPC Error Code .....                                                                                | 167 |
| Table B.43 – Select request service mapping .....                                                                                    | 168 |
| Table B.44 – SelectWithValue service parameter mapping .....                                                                         | 169 |
| Table B.45 – Cancel service parameter mapping .....                                                                                  | 170 |
| Table B.46 – Cancel negative response mapping to IEM ServiceError .....                                                              | 170 |
| Table B.47 – Operate service parameter mapping .....                                                                                 | 171 |
| Table B.48 – Operate negative response mapping to IEM ServiceError .....                                                             | 171 |
| Table B.49 – TimeActivatedOperate service parameter mapping .....                                                                    | 172 |
| Table B.50 – TimeActivatedOperate negative response mapping to IEM ServiceError .....                                                | 173 |
| Table B.51 – Protocol stack details .....                                                                                            | 175 |
| Table C.1 – Mapping of IEC 61400-25-3 IEM to ISO 9506 according to IEC 61850-8-1 .....                                               | 177 |
| Table C.2 – QueryLogByTime mapping .....                                                                                             | 179 |
| Table C.3 – QueryLogAfter mapping .....                                                                                              | 179 |
| Table C.4 – Service and protocols for client/server communication A-Profile .....                                                    | 180 |
| Table C.5 – Service and protocols for client/server TCP/IP T-Profile .....                                                           | 180 |
| Table D.1 – Services Mapping overview of IEC 61400-25 IM and IEM .....                                                               | 184 |
| Table D.2 – Example for mapping of LD and LN to CASDU and IOA .....                                                                  | 186 |
| Table D.3 – Logical device mapping .....                                                                                             | 187 |
| Table D.4 – Logical node mapping .....                                                                                               | 187 |
| Table D.5 – CDCs defined in IEC 61400-25-2 .....                                                                                     | 188 |
| Table D.6 – CDC: Status Value, STV class .....                                                                                       | 188 |
| Table D.7 – CDC: Setpoint Value, SPV class .....                                                                                     | 188 |
| Table D.8 – CDC: Alarm, ALM class .....                                                                                              | 189 |
| Table D.9 – CDC: Command CMD class .....                                                                                             | 189 |
| Table D.10 – CDC: Event Counting, CTE class .....                                                                                    | 189 |
| Table D.11 – CDC: State Timing, TMS class .....                                                                                      | 190 |
| Table D.12 – Mapping structure basic CDC .....                                                                                       | 190 |
| Table D.13 – CDC: Controllable Analog set point, APC class .....                                                                     | 192 |
| Table D.14 – CDC: Controllable analogue set point information (APC) mapping of data attributes of the Functional Constraint MX ..... | 192 |
| Table D.15 – CDC: Controllable Analog set point, APC class mapping of data and attributes of the Functional Constraint CO .....      | 193 |
| Table D.16 – CDC: Enumerated status, ENS class .....                                                                                 | 193 |
| Table D.17 – CDC: Enumerated status, ENS class mapping of data and attributes of the Functional Constraint ST .....                  | 194 |
| Table D.18 – CDC: ENC Controllable enumerated status, class ENC .....                                                                | 195 |

|                                                                                                                                  |     |
|----------------------------------------------------------------------------------------------------------------------------------|-----|
| Table D.19 – CDC: Controllable enumerated status, ENC class mapping of data and attributes of the Functional Constraint CO ..... | 195 |
| Table D.20 – CDC: ENG Enumerated status setting, class ENG .....                                                                 | 197 |
| Table D.21 – Relationship between complex CDCs and IEC 60870-5-104 ASDUs .....                                                   | 197 |
| Table D.22 – Mapping of IEC 61400-25 ACSI service into IEC 60870-5-104 services .....                                            | 198 |
| Table E.1 – Services requiring Client/Server Communication Profile .....                                                         | 227 |
| Table E.2 – CDC: Setpoint Parameter Value (SPV) mapping .....                                                                    | 229 |
| Table E.3 – CDC: Status Value (STV) mapping .....                                                                                | 230 |
| Table E.4 – CDC: Alarm (ALM) mapping .....                                                                                       | 231 |
| Table E.5 – CDC: Command (CMD) mapping .....                                                                                     | 232 |
| Table E.6 – CDC: Event Counting (CTE) mapping .....                                                                              | 233 |
| Table E.7 – CDC: State Timing (TMS) mapping .....                                                                                | 234 |
| Table E.8 – CDC: Device Name Plate (WDPL) mapping .....                                                                          | 235 |
| Table E.9 – CDC: Alarm Set Status (AST) mapping .....                                                                            | 236 |

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**WIND ENERGY GENERATION SYSTEMS –****Part 25-4: Communications for monitoring  
and control of wind power plants –  
Mapping to communication profile**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61400-25-4 has been prepared by IEC technical committee 88: Wind energy generation systems.

This second edition cancels and replaces the first edition published in 2008. This edition constitutes a technical revision.

The main technical changes with regard to the previous edition are as follows:

General harmonization with information models in IEC 61400-25-2 and information exchange services in IEC 61400-25-3.

Reduction of overlap between standards and simplification by increased referencing.

For Annex A Webservices: Changes are limited to harmonization with IEC 61850 and with other parts of IEC 61400-25. Updating of webservices to use soap over websockets have been considered.

Maintenance of Annex B OPC/XML-DA included an evaluation of the use of custom item properties. OPC UA was not chosen as basis for IEC 61850-8-2, however the work of TS 61400-25-41 is currently considering if OPC UA can replace the existing OPC/XML-DA mapping in future editions of IEC 61400-25-4. A mapping to OPC UA is thus not part of this second edition of IEC 61400-25-4, but could be submitted as a separate document.

The mapping to IEC 61850-8-1 in Annex C is harmonized with the latest edition of IEC 61850-8-1.

The mapping to IEC 60870-5-104 in Annex D includes further harmonization with IEC 61850-80-1.

Finally, Annex E DNP3 is harmonized with the latest version of IEEE 1815-1. This includes an adaptation to support wind power specific models.

- a) Mapping of AddSubscription and RemoveSubscription services have been removed, to be in line with IEC 61400-25-3.
- b) Tables indicating services supported have been replaced by tables in accordance with IEC 61400-25-3:2015 Annex D including ACSI conformance statements for clients and servers, individually.
- c) Technical issues (Tissues) for IEC 61850-7-2:2010 have been considered and changes have been made accordingly
- d) Technical issues (Tissues), as collected by the IEC 61400-25 users group USE61400-25, have been considered, and changes have been made accordingly.
- e) The changes made to Annex A includes the following: Mapping to object classes has been removed for objects (Server, LD, LN, Data Set, RCB, UCB, LCB and Log) not used in the services. Object names are defined as names of complex types instead of elements. Faulty references have been removed. WSDL tags have been renamed for better alignment and consistency. Values for maximum message size are specified. Mapping to service GetAllDataValues have been added. Examples have been introduced for typical service requests and responses. A new version of the WSDL has been created, validated with XmlSpy.
- f) The changes to Annex B OPC/XML-DA have been made in accordance with the scope of the revision. Main focus has been on the mapping of the Array type, of the GetAllDataValues service, of the report model and the control services.
- g) The technical change made to Annex C is an adaptation of TCP/IP Profile services according to the changes in IEC 61850-8-1:2011 (Communication and link redundancy added).
- h) The most important change in Annex D is the synchronization with the second edition of referenced IEC 61850 standards. In accordance with the work on IEC 61850-80-1 Edition 2 the new CDCs are mapped to IEC 60870-5-104. Also an interoperability list for the IEC 61400-25-4 Mapping IEC 60870-5-104 has been created, as a subset of the interoperability list of IEC 61850-80-1.
- i) Annex E (DNP3) has been updated to use the same approach as IEEE 1815.1. It describes how to translate the IEC 61400-25-2 common data class attributes to DNP3 points. The use of DNP3 datasets described in IEC 61400-25-4:2008 has been removed, as it did not offer a flexible approach to map the IEC 61400-25-2 information.

The text of this standard is based on the following documents:

| FDIS        | Report on voting |
|-------------|------------------|
| 88/600/FDIS | 88/607/RVD       |

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61400 series, published under the general title *Wind energy generation systems*, can be found on the IEC website.

For the user's convenience, a file containing the text of Clause A.7 is included with this document.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## INTRODUCTION

The IEC 61400-25 series defines communications for monitoring and control of wind power plants. The architecture of the IEC 61400-25 series has been selected to provide an abstract definition of classes and services such that the specifications are independent of specific protocol stacks, implementations, and operating systems. This part of IEC 61400-25 specifies the mapping of these abstract classes and services to protocol stacks.

NOTE Performance of the IEC 61400-25 series implementations are application-specific. The IEC 61400-25 series does not guarantee a certain level of performance. This is beyond the scope of the IEC 61400-25 series. However, there is no underlying limitation in the communications technology to prevent high-speed application (millisecond level responses).

## **WIND ENERGY GENERATION SYSTEMS –**

### **Part 25-4: Communications for monitoring and control of wind power plants – Mapping to communication profile**

#### **1 Scope**

The focus of the IEC 61400-25 series is on the communications between wind power plant components such as wind turbines and actors such as SCADA systems. Internal communication within wind power plant components is outside the scope of the IEC 61400-25 series.

The IEC 61400-25 series is designed for a communication environment supported by a client-server model. Three areas are defined, that are modelled separately to ensure the scalability of implementations:

- a) wind power plant information model,
- b) information exchange model, and
- c) mapping of these two models to a standard communication profile.

The wind power plant information model and the information exchange model, viewed together, constitute an interface between client and server. In this conjunction, the wind power plant information model serves as an interpretation frame for available wind power plant information. The wind power plant information model is used by the server to offer the client a uniform, component-oriented view of the wind power plant data. The information exchange model reflects the whole active functionality of the server. The IEC 61400-25 series enables connectivity between a heterogeneous combination of client and servers from different manufacturers and suppliers.

As depicted in Figure 1, the IEC 61400-25 series defines a server with the following aspects:

- Information provided by a wind power plant component, for example, ‘wind turbine rotor speed’ or ‘total power production of a certain time interval’ is modelled and made available for access. The information modelled in the IEC 61400-25 series is defined in IEC 61400-25-2.
- Services to exchange values of the modelled information, defined in IEC 61400-25-3.
- Mapping to a communication profile, providing a protocol stack to carry the messages, i.e. the service requests and responses and the values from the modelled information (IEC 61400-25-4).

IEC 61400-25-5 defines test cases associated with information, services and protocol stacks for conformance testing of both servers and clients.

The IEC 61400-25 series only defines how to model the information, information exchange and mapping to specific communication protocols. The IEC 61400-25 series excludes a definition of how and where to implement the communication interface, the application program interface and implementation recommendations. However, the objective of the IEC 61400-25 series is that the information associated with a single wind power plant component (such as a wind turbine) is accessible through a corresponding logical device.


This part of the IEC 61400-25 series specifies the specific mappings to protocol stacks encoding the messages required for the information exchange between a client and a remote server for:

- data access and retrieval,
- device control,
- event reporting and logging,
- publisher/subscriber,
- self-description of devices (device data dictionary),
- data typing and discovery of data types.

The mappings specified in this part of IEC 61400-25 comprise:

- a mapping to SOAP-based web services,
- a mapping to OPC/XML-DA,
- a mapping to IEC 61850-8-1 MMS,
- a mapping to IEC 60870-5-104,
- a mapping to DNP3.

All mappings are optional, but at least one optional mapping needs to be selected in order to be compliant with this part of IEC 61400-25.

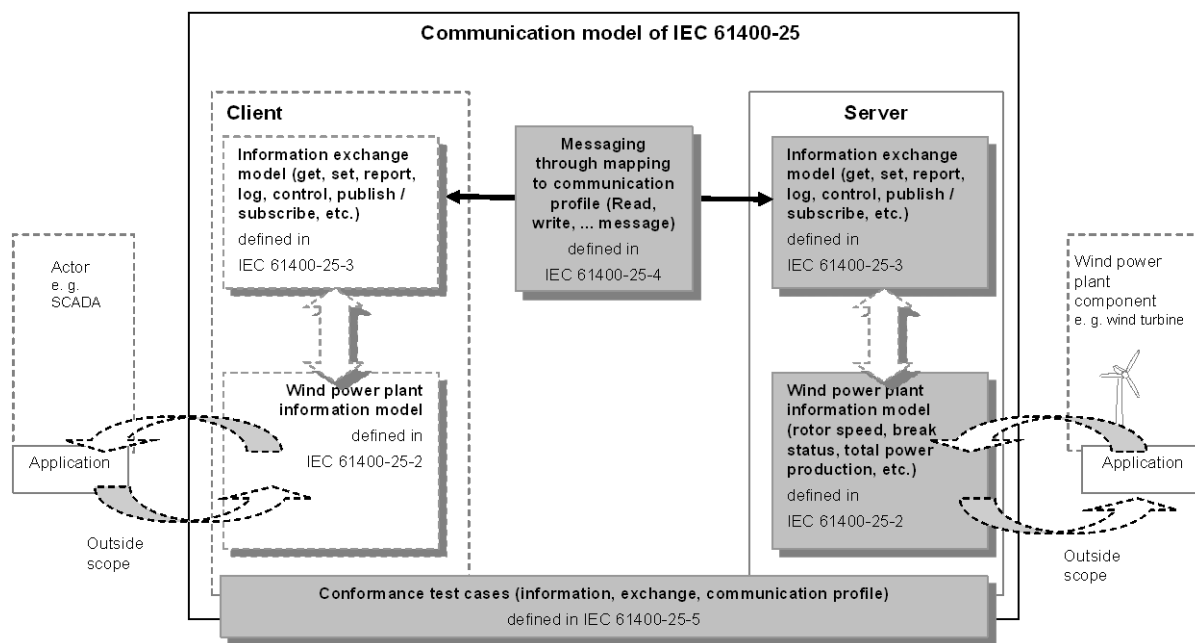

IEC

**Figure 1 – Conceptual communication model of IEC 61400-25 series**

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60870-5-4:1993, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 4: Definition and coding of application information elements*

IEC 60870-5-5:1995, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 5: Basic application functions*

IEC 60870-5-101:2003, *Telecontrol equipment and systems – Part 5-101: Transmission protocols – Companion standard for basic telecontrol tasks*

IEC 60870-5-104:2006, *Telecontrol equipment and systems – Part 5-104: Transmission protocols – Network access for IEC 60870-5-101 using standard transport profiles*

IEC 61400-25-1:2006, *Wind turbines – Part 25-1: Communications for monitoring and control of wind power plants – Overall description of principles and models*

IEC 61400-25-2:2015, *Wind turbines – Part 25-2: Communications for monitoring and control of wind power plants – Information models*

IEC 61400-25-3:2015, *Wind turbines – Part 25-3: Communications for monitoring and control of wind power plants – Information exchange models*

IEC 61400-25-5:2006, *Wind turbines – Part 25-5: Communications for monitoring and control of wind power plants – Conformance testing*

IEC 61850-6:2009, *Communication networks and systems for power utility automation – Part 6: Configuration description language for communication in electrical substations related to IEDs*

IEC 61850-7-2:2010, *Communication networks and systems for power utility automation – Part 7-2: Basic information and communication structure – Abstract communication service interface (ACSI)*

IEC 61850-7-3:2010, *Communication networks and systems for power utility automation – Part 7-3: Basic communication structure – Common data classes*

IEC 61850-8-1:2011, *Communication networks and systems for power utility automation – Part 8-1: Specific Communication Service Mapping (SCSM) – Mappings to MMS (ISO 9506-1 and ISO 9506-2) and to ISO/IEC 8802-3*

IEC TS 61850-80-1:2008, *Communication networks and systems for power utility automation – Part 80-1: Guideline to exchanging information from a CDC-based data model using IEC 60870-5-101 or IEC 60870-5-104*

IEC 62439-3:2016, *Industrial communication networks – High availability automation networks – Part 3: Parallel Redundancy Protocol (PRP) and High-availability Seamless Redundancy (HSR)*

ISO 639-2, *Codes for the representation of names of languages – Part 2: Alpha-3 code*

ISO/IEC 8326:1996, *Information technology – Open Systems Interconnection – Session service definition*

ISO/IEC 8327-1:1996, *Information technology – Open Systems Interconnection – Connection-oriented Session protocol: Protocol specification*

ISO/IEC 8649:1996, *Information technology – Open Systems Interconnection – Service definition for the Association Control Service Element*

ISO/IEC 8650-1:1996, *Information technology – Open Systems Interconnection – Connection-oriented protocol for the Association Control Service Element: Protocol specification*

ISO/IEC 8822:1994, *Information technology – Open Systems Interconnection – Presentation service definition*

ISO/IEC 8823-1:1994, *Information technology – Open Systems Interconnection – Connection-oriented presentation protocol: Protocol specification*

ISO/IEC 8824-1:2015, *Information technology – Abstract Syntax Notation One (ASN.1): Specification of basic notation*

ISO/IEC 8825-1:2015, *Information technology – ASN.1 encoding rules: Specification of Basic Encoding Rules (BER), Canonical Encoding Rules (CER) and Distinguished Encoding Rules (DER)*

ISO 9506-1:2003, *Industrial automation systems – Manufacturing Message Specification – Part 1: Service definition*

ISO 9506-2:2003, *Industrial automation systems – Manufacturing Message Specification – Part 2: Protocol specification*

W3C, *Web Services Architecture*, <http://www.w3.org/TR/2002/WD-ws-arch-20021114/>

W3C, *Extensible Markup Language (XML) 1.0*, <http://www.w3.org/TR/2000/REC-xml-20001006>

SOAP ver. 1.1, *W3C Note Simple Object Access Protocol (SOAP) 1.1*, 8 May 2000. <http://www.w3.org/TR/2006/NOTE-soap11-ror-httpbinding-20060321/#reqoptrespbinding> and <http://www.w3.org/TR/2000/NOTE-SOAP-20000508/> (Referenced in Annex B)

SOAP ver. 1.2, *W3C*, 27. April 2007: <http://www.w3.org/TR/soap> (Referenced in Annex A)

RFC 791, *Internet Protocol specification (IP)*

RFC 792, *Internet Control Message Protocol (ICMP)*

RFC 793, *Transmission Control Protocol (TCP)*

RFC 826, *Ethernet Address Resolution Protocol*

RFC 919, *Broadcasting internet datagrams*

RFC 922, *Broadcasting internet datagrams in presence of subnets*

RFC 950, *Internet Standard Subnetting Procedure*

RFC 1006, *ISO Transport Service on top of the TCP Version: 3*

RFC 1112, *Host Extensions for IP Multicasting*

RFC 1122, *Requirements for Internet Hosts – Communication Layers*, IETF

RFC 2200, *Internet Official Protocol Standards, Request for Comments 2200*, June 1997

RFC 2616, *Hypertext Transfer Protocol – HTTP/1.1*

RFC 2817, *Upgrading to TLS Within HTTP/1.1*

RFC 4122, *Universally Unique IDentifier (UUID) URN Namespace*

RFC 5246, *Transport Layer Security (TLS version 1.2) protocol*

OPC XML-DA Specification. Version 1.01, 18 December 2004

IEEE Std 754:1985, *IEEE Standard for Binary Floating-Point Arithmetic*

IEEE 802.1D:2004, *IEEE Standard for Local and Metropolitan Area Networks: Media access control (MAC) Bridges*

IEEE P1815.1:2015, *Standard for exchanging Information between networks implementing IEC 61850 and IEEE Std 1815 (Distributed Network Protocol – DNP3)*

## SOMMAIRE

|                                                                                                                               |     |
|-------------------------------------------------------------------------------------------------------------------------------|-----|
| AVANT-PROPOS .....                                                                                                            | 250 |
| INTRODUCTION.....                                                                                                             | 253 |
| 1 Domaine d'application .....                                                                                                 | 254 |
| 2 Références normatives .....                                                                                                 | 255 |
| 3 Termes et définitions .....                                                                                                 | 258 |
| 4 Termes abrégés .....                                                                                                        | 258 |
| 5 Aperçu général .....                                                                                                        | 260 |
| 5.1 Généralités .....                                                                                                         | 260 |
| 5.2 Mapping pour les piles de protocoles .....                                                                                | 260 |
| 5.3 Services de l'IEC 61400-25-3 mappés pour les piles de protocoles .....                                                    | 261 |
| Annexe A (normative) Mapping des services de communication spécifiques –<br>Définition et mapping pour les services web ..... | 263 |
| A.1 Généralités .....                                                                                                         | 263 |
| A.1.1 Introduction à la définition et au mapping pour les services web .....                                                  | 263 |
| A.1.2 Domaine d'application de la définition et du mapping pour les services<br>web .....                                     | 263 |
| A.1.3 Architecture du mapping .....                                                                                           | 263 |
| A.2 Mapping du modèle d'information de l'IEC 61400-25 pour les services web .....                                             | 266 |
| A.2.1 Introduction générale au mapping pour les services web .....                                                            | 266 |
| A.2.2 Classe DATA OBJECT.....                                                                                                 | 269 |
| A.2.3 Définition DATA ATTRIBUTE .....                                                                                         | 269 |
| A.3 Mapping du modèle d'échange d'information pour les services web .....                                                     | 270 |
| A.3.1 Généralités .....                                                                                                       | 270 |
| A.3.2 Mapping des services relatifs à la classe SERVER .....                                                                  | 270 |
| A.3.3 Mapping des services de la classe LOGICAL-DEVICE .....                                                                  | 277 |
| A.3.4 Mapping des services de la classe LOGICAL-NODE .....                                                                    | 278 |
| A.3.5 Mapping des services de la classe DATA .....                                                                            | 282 |
| A.3.6 Mapping des services de la classe DATA-SET .....                                                                        | 292 |
| A.3.7 Mapping de services de la classe REPORT-CONTROL-BLOCK (RCB) .....                                                       | 299 |
| A.3.8 Mapping de services de la classe LOG-CONTROL-BLOCK (LCB).....                                                           | 315 |
| A.3.9 Mapping des services de la classe LOG .....                                                                             | 319 |
| A.3.10 Mapping des services de la classe CONTROL .....                                                                        | 323 |
| A.4 Détails de la pile de protocoles .....                                                                                    | 336 |
| A.5 Spécification WSDL pour la définition et le mapping pour les services web .....                                           | 337 |
| Annexe B (normative) Mapping des services de communication spécifiques – Mapping<br>pour OPC XML-DA.....                      | 371 |
| B.1 Généralités .....                                                                                                         | 371 |
| B.1.1 Introduction au mapping pour OPC XML-DA .....                                                                           | 371 |
| B.1.2 Domaine d'application du mapping pour OPC XML-DA .....                                                                  | 371 |
| B.1.3 Architecture du mapping .....                                                                                           | 371 |
| B.2 Mapping du modèle d'information de l'IEC 61400-25 pour OPC XML-DA.....                                                    | 373 |
| B.2.1 Mapping des classes de modèle d'information de l'IEC 61400-25-2 pour<br>OPC XML-DA .....                                | 373 |
| B.2.2 Serveur.....                                                                                                            | 374 |
| B.2.3 Logical Device .....                                                                                                    | 374 |
| B.2.4 Logical Node .....                                                                                                      | 375 |

|                                                                                                                                                |                                                                                                                 |     |
|------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------|-----|
| B.2.5                                                                                                                                          | Data Object .....                                                                                               | 375 |
| B.2.6                                                                                                                                          | Data Attribute .....                                                                                            | 376 |
| B.3                                                                                                                                            | Mapping du modèle d'échange d'information pour les services OPC XML-DA .....                                    | 382 |
| B.3.1                                                                                                                                          | Généralités .....                                                                                               | 382 |
| B.3.2                                                                                                                                          | Modèle d'association .....                                                                                      | 383 |
| B.3.3                                                                                                                                          | Classe Server Services – GetServerDirectory .....                                                               | 386 |
| B.3.4                                                                                                                                          | Services de la classe Logical Device – GetLogicalDeviceDirectory .....                                          | 388 |
| B.3.5                                                                                                                                          | Services de la classe Logical Node .....                                                                        | 390 |
| B.3.6                                                                                                                                          | Services de la classe Data .....                                                                                | 392 |
| B.3.7                                                                                                                                          | Modèle de Data set .....                                                                                        | 400 |
| B.3.8                                                                                                                                          | Modèle Report .....                                                                                             | 404 |
| B.3.9                                                                                                                                          | Modèle de commande .....                                                                                        | 408 |
| B.4                                                                                                                                            | Détails de la pile de protocoles .....                                                                          | 418 |
| Annexe C (normative) Mapping des services de communication spécifiques – Mapping pour ISO 9506 indiqué dans l'IEC 61850-8-1 .....              |                                                                                                                 | 420 |
| C.1                                                                                                                                            | Généralités .....                                                                                               | 420 |
| C.1.1                                                                                                                                          | Introduction au mapping pour l'ISO 9506 indiqué dans l'IEC 61850-8-1 .....                                      | 420 |
| C.1.2                                                                                                                                          | Domaine d'application du mapping pour ISO 9506 indiqué dans l'IEC 61850-8-1 .....                               | 420 |
| C.1.3                                                                                                                                          | Architecture du mapping .....                                                                                   | 420 |
| C.2                                                                                                                                            | Mapping du modèle d'information de l'IEC 61400-25 pour l'ISO 9506 comme indiqué dans l'IEC 61850-8-1 .....      | 422 |
| C.2.1                                                                                                                                          | Généralités .....                                                                                               | 422 |
| C.2.2                                                                                                                                          | Services de journalisation étendus .....                                                                        | 423 |
| C.3                                                                                                                                            | Détails de la pile de protocoles .....                                                                          | 423 |
| C.3.1                                                                                                                                          | Généralités .....                                                                                               | 423 |
| C.3.2                                                                                                                                          | Profil A .....                                                                                                  | 423 |
| C.3.3                                                                                                                                          | Profil T TCP/IP .....                                                                                           | 424 |
| Annexe D (normative) Mapping des services de communication spécifiques – Mapping pour l'IEC 60870-5-104 indiqué dans l'IEC TS 61850-80-1 ..... |                                                                                                                 | 426 |
| D.1                                                                                                                                            | Généralités .....                                                                                               | 426 |
| D.1.1                                                                                                                                          | Introduction au mapping pour l'IEC 60870-5-104 indiqué dans l'IEC TS 61850-80-1 .....                           | 426 |
| D.1.2                                                                                                                                          | Domaine d'application du mapping pour l'IEC 60870-5-104 indiqué dans l'IEC TS 61850-80-1 .....                  | 426 |
| D.1.3                                                                                                                                          | Architecture du mapping .....                                                                                   | 426 |
| D.2                                                                                                                                            | Mapping du modèle d'information de l'IEC 61400-25 pour l'IEC 60870-5-104 indiqué dans l'IEC TS 61850-80-1 ..... | 430 |
| D.2.1                                                                                                                                          | Généralités .....                                                                                               | 430 |
| D.2.2                                                                                                                                          | Mapping de la classe IM Logical Device .....                                                                    | 431 |
| D.2.3                                                                                                                                          | Mapping de la classe IM Logical Node .....                                                                      | 432 |
| D.3                                                                                                                                            | Mapping des données du modèle d'information de l'IEC 61400-25 pour l'IEC 60870-5-104 .....                      | 432 |
| D.3.1                                                                                                                                          | Mapping des classes de données communes (CDC) .....                                                             | 432 |
| D.4                                                                                                                                            | Mapping du modèle d'échange d'information pour les services de l'IEC 60870-5-104 .....                          | 444 |
| D.4.1                                                                                                                                          | Liste des modèles de services et des mappings correspondants .....                                              | 444 |
| D.4.2                                                                                                                                          | Mapping de la classe Control .....                                                                              | 446 |
| D.5                                                                                                                                            | Sélections des piles de protocoles pour l'IEC 60870-5-104 (Détails de la pile de protocoles) .....              | 459 |
| D.5.1                                                                                                                                          | Généralités .....                                                                                               | 459 |

|                                                                                                        |                                                                                                                                                  |     |
|--------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------|-----|
| D.5.2                                                                                                  | Structure des données d'application .....                                                                                                        | 459 |
| D.5.3                                                                                                  | Interopérabilité avec l'IEC 60870-5-104 .....                                                                                                    | 459 |
| D.6                                                                                                    | Utilisation de l'extension SCL (Substation Configuration Language) pour<br>inclure les informations de l'IEC 60870-5-101/104 (informative) ..... | 472 |
| D.6.1                                                                                                  | Généralités .....                                                                                                                                | 472 |
| D.6.2                                                                                                  | Hiérarchie du modèle d'information SCL .....                                                                                                     | 472 |
| D.6.3                                                                                                  | Syntaxe des sections Private de l'IEC 60870-5-101/104 .....                                                                                      | 472 |
| D.6.4                                                                                                  | Configuration des paramètres de communication de l'IEC 60870-5-104<br>au moyen du SCL .....                                                      | 472 |
| Annexe E (normative) Mapping des services de communication spécifiques – Mapping<br>pour DNP3 .....    |                                                                                                                                                  | 473 |
| E.1                                                                                                    | Généralités .....                                                                                                                                | 473 |
| E.1.1                                                                                                  | Introduction au mapping pour DNP3 .....                                                                                                          | 473 |
| E.1.2                                                                                                  | Domaine d'application du mapping pour DNP3 .....                                                                                                 | 473 |
| E.1.3                                                                                                  | Architecture du mapping .....                                                                                                                    | 473 |
| E.2                                                                                                    | Mapping du modèle d'information de l'IEC 61400-25 pour DNP3 .....                                                                                | 476 |
| E.2.1                                                                                                  | Mapping des classes de données communes héritées de l'IEC 61850-7-<br>3 .....                                                                    | 476 |
| E.2.2                                                                                                  | CDC Setpoint Parameter Value (SPV) .....                                                                                                         | 476 |
| E.2.3                                                                                                  | CDC Status Value (STV) .....                                                                                                                     | 477 |
| E.2.4                                                                                                  | CDC Alarm (ALM) .....                                                                                                                            | 478 |
| E.2.5                                                                                                  | CDC Command (CMD) .....                                                                                                                          | 479 |
| E.2.6                                                                                                  | CDC Event Counting (CTE) .....                                                                                                                   | 480 |
| E.2.7                                                                                                  | CDC State Timing (TMS) .....                                                                                                                     | 481 |
| E.2.8                                                                                                  | CDC Device Name Plate (WDPL) .....                                                                                                               | 482 |
| E.2.9                                                                                                  | CDC Alarm Set Status (AST) .....                                                                                                                 | 483 |
| E.3                                                                                                    | Mapping du modèle d'échange d'information pour les services DNP3 .....                                                                           | 484 |
| Annexe F (normative) Synchronisation temporelle .....                                                  |                                                                                                                                                  | 485 |
| F.1                                                                                                    | Généralités .....                                                                                                                                | 485 |
| F.2                                                                                                    | Profil A .....                                                                                                                                   | 485 |
| F.3                                                                                                    | Profil T .....                                                                                                                                   | 485 |
| Annexe G (informative) Interfaces – Considérations de mise en œuvre .....                              |                                                                                                                                                  | 486 |
| G.1                                                                                                    | Généralités .....                                                                                                                                | 486 |
| G.2                                                                                                    | Exemples d'interfaces d'un système réel .....                                                                                                    | 486 |
| Bibliographie .....                                                                                    |                                                                                                                                                  | 488 |
| Figure 1 – Modèle de communication conceptuelle de la série IEC 61400-25 .....                         |                                                                                                                                                  | 255 |
| Figure 2 – Profils de communication .....                                                              |                                                                                                                                                  | 261 |
| Figure A.1 – Architecture du mapping (conceptuel) .....                                                |                                                                                                                                                  | 264 |
| Figure A.2 – Structure de nom appliquée dans la série IEC 61400-25 (conceptuelle) .....                |                                                                                                                                                  | 267 |
| Figure A.3 – Comportement du client dans le service d'établissement de rapports<br>(conceptuel) .....  |                                                                                                                                                  | 301 |
| Figure A.4 – Comportement du serveur dans le service d'établissement de rapports<br>(conceptuel) ..... |                                                                                                                                                  | 302 |
| Figure A.5 – Mécanisme des services d'établissement de rapports (conceptuel) .....                     |                                                                                                                                                  | 304 |
| Figure B.1 – Architecture du mapping (conceptuel) .....                                                |                                                                                                                                                  | 372 |
| Figure B.2 – Différences entre les horodatages OPC XML-DA et du modèle<br>d'information IEC .....      |                                                                                                                                                  | 380 |

|                                                                                                       |         |
|-------------------------------------------------------------------------------------------------------|---------|
| Figure B.3 – Séquence des services permettant d'établir une association .....                         | 386     |
| Figure B.4 – Séquence de services CreateDataSet .....                                                 | 402     |
| Figure C.1 – Architecture du mapping (conceptuel) .....                                               | 421     |
| Figure D.1 – Architecture du mapping (conceptuel) .....                                               | 428     |
| Figure D.2 – Commande directe avec sécurité normale avec mise à jour de statut – cas positif .....    | 447     |
| Figure D.3 – Commande directe avec sécurité normale en général – cas négatif a) .....                 | 448     |
| Figure D.4 – Commande directe avec sécurité normale en général – cas négatif b) .....                 | 448     |
| Figure D.5 – Commande directe avec sécurité normale avec mise à jour de statut – cas négatif c) ..... | 449     |
| Figure D.6 – Commande directe avec sécurité normale sans mise à jour de statut – cas positif .....    | 450     |
| Figure D.7 – Commande directe avec sécurité renforcée – cas positif .....                             | 451     |
| Figure D.8 – Commande directe avec sécurité renforcée – cas négatif c) .....                          | 452     |
| Figure D.9 – Commande directe avec sécurité renforcée – cas négatif d) .....                          | 453     |
| Figure D.10 – Commande SBOw – cas positif .....                                                       | 454     |
| Figure D.11 – Commande SBOw – cas négatif a) .....                                                    | 454     |
| Figure D.12 – Commande SBOw – cas négatif b) .....                                                    | 455     |
| Figure D.13 – Commande SBOw – cas négatif c) .....                                                    | 456     |
| Figure D.14 – Commande SBO avec sécurité renforcée – cas positif .....                                | 457     |
| Figure D.15 – Commande SBO avec sécurité renforcée – cas négatif a) .....                             | 458     |
| Figure D.16 – Commande SBO avec sécurité renforcée – cas négatif b) .....                             | 459     |
| Figure E.1 – Architecture du mapping (conceptuel) .....                                               | 474     |
| Figure G.1 – Exemple de mise en œuvre .....                                                           | 487     |
| <br>Tableau 1 – Aperçu général des mappings des services de l'IEC 61400-25-3 .....                    | <br>262 |
| Tableau A.1 – Aperçu général du mapping des services web des IM et IEM de l'IEC 61400-25 .....        | 265     |
| Tableau A.2 – Mapping des IM de l'IEC 61400-25 pour les services web .....                            | 266     |
| Tableau A.3 – Schéma XML pour le modèle d'information de la centrale éolienne .....                   | 269     |
| Tableau A.4 – Services relatifs à la classe SERVER mappés pour les services web .....                 | 270     |
| Tableau A.5 – GetServerDirectoryRequest .....                                                         | 271     |
| Tableau A.6 – GetServerDirectoryResponse .....                                                        | 271     |
| Tableau A.7 – AssociateRequest .....                                                                  | 273     |
| Tableau A.8 – AssociateResponse .....                                                                 | 274     |
| Tableau A.9 – ReleaseRequest .....                                                                    | 275     |
| Tableau A.10 – ReleaseResponse .....                                                                  | 275     |
| Tableau A.11 – AbortRequest .....                                                                     | 276     |
| Tableau A.12 – AbortResponse .....                                                                    | 276     |
| Tableau A.13 – Mapping des services LOGICAL-DEVICE .....                                              | 277     |
| Tableau A.14 – GetLogicalDeviceDirectoryRequest .....                                                 | 277     |
| Tableau A.15 – GetLogicalDeviceDirectoryResponse .....                                                | 278     |
| Tableau A.16 – Mapping des services LOGICAL-NODE .....                                                | 278     |
| Tableau A.17 – GetLogicalNodeDirectoryRequest .....                                                   | 279     |

|                                                               |     |
|---------------------------------------------------------------|-----|
| Tableau A.18 – GetLogicalNodeDirectoryResponse .....          | 280 |
| Tableau A.19 – GetAllDataValuesRequest .....                  | 281 |
| Tableau A.20 – GetAllDataValuesResponse .....                 | 281 |
| Tableau A.21 – Mapping des services Data .....                | 282 |
| Tableau A.22 – GetDataValuesRequest .....                     | 282 |
| Tableau A.23 – GetDataValuesResponse .....                    | 283 |
| Tableau A.24 – SetDataValuesRequest .....                     | 286 |
| Tableau A.25 – SetDataValuesResponse .....                    | 287 |
| Tableau A.26 – GetDataDirectoryRequest.....                   | 287 |
| Tableau A.27 – GetDataDirectoryResponse .....                 | 288 |
| Tableau A.28 – GetDataDefinitionRequest .....                 | 289 |
| Tableau A.29 – GetDataDefinitionResponse .....                | 290 |
| Tableau A.30 – Mapping des services DATA-SET .....            | 292 |
| Tableau A.31 – GetDataSetValuesRequest.....                   | 293 |
| Tableau A.32 – GetDataSetValuesResponse .....                 | 293 |
| Tableau A.33 – SetDataSetValuesRequest .....                  | 295 |
| Tableau A.34 – SetDataSetValuesResponse.....                  | 295 |
| Tableau A.35 – CreateDataSetRequest.....                      | 296 |
| Tableau A.36 – CreateDataSetResponse .....                    | 297 |
| Tableau A.37 – DeleteDataSetRequest .....                     | 297 |
| Tableau A.38 – DeleteDataSetResponse .....                    | 298 |
| Tableau A.39 – GetDataSetDirectoryRequest .....               | 299 |
| Tableau A.40 – GetDataSetDirectoryResponse .....              | 299 |
| Tableau A.41 – Mapping des services Report control block..... | 300 |
| Tableau A.42 – ReportFormat .....                             | 305 |
| Tableau A.43 – GetBRCBValuesRequest .....                     | 306 |
| Tableau A.44 – GetBRCBValuesResponse .....                    | 307 |
| Tableau A.45 – SetBRCBValuesRequest .....                     | 308 |
| Tableau A.46 – SetBRCBValuesResponse.....                     | 310 |
| Tableau A.47 – GetURCBValuesRequest.....                      | 310 |
| Tableau A.48 – GetURCBValuesResponse .....                    | 311 |
| Tableau A.49 – SetURCBValuesRequest .....                     | 312 |
| Tableau A.50 – SetURCBValuesResponse .....                    | 314 |
| Tableau A.51 – ReportRequest .....                            | 314 |
| Tableau A.52 – ReportResponse .....                           | 315 |
| Tableau A.53 – Mapping de services LOG-CONTROL-BLOCK.....     | 315 |
| Tableau A.54 – GetLCBValuesRequest.....                       | 316 |
| Tableau A.55 – GetLCBValuesResponse .....                     | 317 |
| Tableau A.56 – SetLCBValuesRequest .....                      | 318 |
| Tableau A.57 – SetLCBValuesResponse .....                     | 318 |
| Tableau A.58 – Mapping des services de la classe LOG .....    | 319 |
| Tableau A.59 – GetLogStatusValuesRequest.....                 | 319 |
| Tableau A.60 – GetLogStatusValuesResponse .....               | 320 |

|                                                                                                                 |     |
|-----------------------------------------------------------------------------------------------------------------|-----|
| Tableau A.61 – QueryLogByTimeRequest.....                                                                       | 321 |
| Tableau A.62 – QueryLogByTimeResponse .....                                                                     | 322 |
| Tableau A.63 – QueryLogAfterRequest.....                                                                        | 322 |
| Tableau A.64 – QueryLogAfterResponse .....                                                                      | 323 |
| Tableau A.65 – Mapping des services de la classe CONTROL.....                                                   | 324 |
| Tableau A.66 – SelectRequest.....                                                                               | 324 |
| Tableau A.67 – SelectResponse .....                                                                             | 325 |
| Tableau A.68 – SelectWithValueRequest .....                                                                     | 326 |
| Tableau A.69 – SelectWithValueResponse .....                                                                    | 327 |
| Tableau A.70 – CancelRequest.....                                                                               | 328 |
| Tableau A.71 – CancelResponse .....                                                                             | 329 |
| Tableau A.72 – OperateRequest.....                                                                              | 330 |
| Tableau A.73 – OperateResponse .....                                                                            | 331 |
| Tableau A.74 – CommandTerminationRequest .....                                                                  | 332 |
| Tableau A.75 – CommandTerminationResponse .....                                                                 | 332 |
| Tableau A.76 – TimeActivatedOperateRequest .....                                                                | 333 |
| Tableau A.77 – TimeActivatedOperateResponse .....                                                               | 334 |
| Tableau A.78 – TimeActivatedOperateTerminationRequest.....                                                      | 335 |
| Tableau A.79 – TimeActivatedOperateTerminationResponse .....                                                    | 335 |
| Tableau A.80 – Réponse du paramètre AddCause .....                                                              | 336 |
| Tableau A.81 – Sélections de la pile de protocoles .....                                                        | 337 |
| Tableau B.1 – Mapping du service IEM de l'IEC 61400-25-3 pour les services OPC XML-DA .....                     | 373 |
| Tableau B.2 – Mapping des classes d'IM de l'IEC 61400-25-2 pour OPC XML-DA .....                                | 374 |
| Tableau B.3 – Attributs de la classe Server.....                                                                | 374 |
| Tableau B.4 – Attributs de la classe Logical Device .....                                                       | 375 |
| Tableau B.5 – Attributs de la classe Logical Node.....                                                          | 375 |
| Tableau B.6 – Attributs de la classe Data Object .....                                                          | 376 |
| Tableau B.7 – Attributs de la classe Data Attribute .....                                                       | 376 |
| Tableau B.8 – Mapping de l'attribut Basic Types.....                                                            | 377 |
| Tableau B.9 – Nouveaux codes d'erreur OPC XML-DA .....                                                          | 379 |
| Tableau B.10 – Mapping de Timestamp .....                                                                       | 380 |
| Tableau B.11 – Mapping de l'attribut Quality.....                                                               | 380 |
| Tableau B.12 – Explication des paramètres du cookie .....                                                       | 384 |
| Tableau B.13 – Mapping IEM GetServerDirectory .....                                                             | 387 |
| Tableau B.14 – Mapping IEM GetServerDirectory détaillé .....                                                    | 387 |
| Tableau B.15 – Mapping IEM GetLogicalDeviceDirectory.....                                                       | 388 |
| Tableau B.16 – Mapping IEM GetLogicalDeviceDirectory détaillé.....                                              | 389 |
| Tableau B.17 – Mapping de réponse négative de GetLogicalDeviceDirectory pour le paramètre IEM ServiceError..... | 390 |
| Tableau B.18 – Mapping IEM GetLogicalNodeDirectory .....                                                        | 390 |
| Tableau B.19 – Mapping IEM GetLogicalNodeDirectory détaillé .....                                               | 391 |
| Tableau B.20 – Mapping de réponse négative de GetLogicalNodeDirectory pour le service IEM ServiceError .....    | 392 |

|                                                                                                             |     |
|-------------------------------------------------------------------------------------------------------------|-----|
| Tableau B.21 – Mapping IEM GetDataValues.....                                                               | 393 |
| Tableau B.22 – Mapping IEM GetDataValues détaillé .....                                                     | 394 |
| Tableau B.23 – Mapping de réponse négative de GetDataValues pour le paramètre<br>IEM ServiceError .....     | 395 |
| Tableau B.24 – Mapping IEM SetDataValues .....                                                              | 396 |
| Tableau B.25 – Mapping IEM SetDataValues détaillé.....                                                      | 396 |
| Tableau B.26 – Mapping de réponse négative de SetDataValues pour le paramètre<br>IEM ServiceError .....     | 398 |
| Tableau B.27 – Mapping IEM GetDataDirectory .....                                                           | 398 |
| Tableau B.28 – Mapping IEM GetDataDirectory détaillé .....                                                  | 399 |
| Tableau B.29 – Mapping de réponse négative de GetDataDirectory pour le paramètre<br>IEM ServiceError .....  | 400 |
| Tableau B.30 – Mapping des paramètres du service CreateDataSet .....                                        | 402 |
| Tableau B.31 – Mapping de réponse négative de CreateDataSet pour le paramètre<br>IEM ServiceError .....     | 403 |
| Tableau B.32 – Mapping de réponse négative de GetDataSetValues pour le paramètre<br>IEM ServiceError .....  | 403 |
| Tableau B.33 – Mapping de réponse négative de SetDataSetValues pour le paramètre<br>IEM ServiceError .....  | 404 |
| Tableau B.34 – Valeur contrainte des attributs d'abonnement OPC.....                                        | 405 |
| Tableau B.35 – Subscribe .....                                                                              | 405 |
| Tableau B.36 – Subscription Cancel .....                                                                    | 407 |
| Tableau B.37 – Mapping d'échec pour le paramètre IEM ServiceError .....                                     | 407 |
| Tableau B.38 – Mapping des paramètres de service Report.....                                                | 408 |
| Tableau B.39 – Modèles de commande pris en charge par ce mapping .....                                      | 408 |
| Tableau B.40 – Services de commande pris en charge .....                                                    | 409 |
| Tableau B.41 – Propriétés d'éléments personnalisés inscriptibles du modèle de<br>commande .....             | 410 |
| Tableau B.42 – Mapping du paramètre AddCause pour le code d'erreur OPC .....                                | 411 |
| Tableau B.43 – Mapping du service SelectRequest.....                                                        | 412 |
| Tableau B.44 – Mapping des paramètres du service SelectWithValue.....                                       | 413 |
| Tableau B.45 – Mapping des paramètres du service Cancel .....                                               | 414 |
| Tableau B.46 – Mapping de réponse négative de Cancel pour le paramètre IEM<br>ServiceError .....            | 414 |
| Tableau B.47 – Mapping des paramètres du service Operate.....                                               | 415 |
| Tableau B.48 – Mapping de réponse négative Operate pour le paramètre IEM<br>ServiceError .....              | 415 |
| Tableau B.49 – Mapping des paramètres du service TimeActivatedOperate.....                                  | 416 |
| Tableau B.50 – Mapping de réponse négative TimeActivatedOperate pour le paramètre<br>IEM ServiceError ..... | 417 |
| Tableau B.51 – Détails de la pile de protocoles.....                                                        | 419 |
| Tableau C.1 – Mapping de l'IEM de l'IEC 61400-25-3 pour l'ISO 9506 selon<br>l'IEC 61850-8-1.....            | 421 |
| Tableau C.2 – Mapping du service QueryLogByTime .....                                                       | 423 |
| Tableau C.3 – Mapping du service QueryLogAfter .....                                                        | 423 |
| Tableau C.4 – Services et protocoles pour la communication client/serveur Profil A .....                    | 424 |

|                                                                                                                                                            |     |
|------------------------------------------------------------------------------------------------------------------------------------------------------------|-----|
| Tableau C.5 – Services et protocoles pour la communication client/serveur Profil T TCP/IP .....                                                            | 424 |
| Tableau D.1 – Aperçu général du mapping des services des IM et IEM de l'IEC 61400-25 ..                                                                    | 428 |
| Tableau D.2 – Exemple de mapping de LD et LN pour CASDU et IOA .....                                                                                       | 431 |
| Tableau D.3 – Mapping de Logical Device .....                                                                                                              | 431 |
| Tableau D.4 – Mapping de Logical Node .....                                                                                                                | 432 |
| Tableau D.5 – CDC définies dans l'IEC 61400-25-2 .....                                                                                                     | 433 |
| Tableau D.6 – CDC: Status Value, classe STV .....                                                                                                          | 433 |
| Tableau D.7 – CDC: Setpoint Value, classe SPV .....                                                                                                        | 433 |
| Tableau D.8 – CDC: Alarm, classe ALM .....                                                                                                                 | 434 |
| Tableau D.9 – CDC: Command, Classe CMD .....                                                                                                               | 434 |
| Tableau D.10 – CDC: Event Counting, classe CTE .....                                                                                                       | 434 |
| Tableau D.11 – CDC: State Timing, classe TMS .....                                                                                                         | 435 |
| Tableau D.12 – Mapping des CDC de base .....                                                                                                               | 436 |
| Tableau D.13 – CDC: Consigne analogique contrôlable, classe APC .....                                                                                      | 437 |
| Tableau D.14 – CDC: Mapping des informations sur la consigne analogique contrôlable (APC) des attributs de données de la contrainte fonctionnelle MX ..... | 438 |
| Tableau D.15 – CDC: Consigne analogique contrôlable, mapping de la classe APC des données et attributs de la contrainte fonctionnelle CO .....             | 439 |
| Tableau D.16 – CDC: Statut énuméré, classe ENS .....                                                                                                       | 439 |
| Tableau D.17 – CDC: Status énuméré, mapping de la classe ENS des données et attributs de la contrainte fonctionnelle ST .....                              | 440 |
| Tableau D.18 – CDC: ENC Statut énuméré contrôlable, classe ENC .....                                                                                       | 441 |
| Tableau D.19 – CDC: Statut énuméré contrôlable, mapping de la classe ENC des données et attributs de la contrainte fonctionnelle CO .....                  | 441 |
| Tableau D.20 – CDC: Paramètre du statut énuméré ENG, classe ENG .....                                                                                      | 443 |
| Tableau D.21 – Relation entre les CDC complexes et les ASDU de l'IEC 60870-5-104 .....                                                                     | 444 |
| Tableau D.22 – Mapping du service ACSI de l'IEC 61400-25 pour les services de l'IEC 60870-5-104 .....                                                      | 444 |
| Tableau E.1 – Services nécessitant un profil de communication client/serveur .....                                                                         | 475 |
| Tableau E.2 – CDC: Mapping de Setpoint Parameter Value (SPV) .....                                                                                         | 477 |
| Tableau E.3 – CDC: Mapping de Status Value (STV) .....                                                                                                     | 478 |
| Tableau E.4 – Mapping de Alarm (ALM) .....                                                                                                                 | 479 |
| Tableau E.5 – CDC: Mapping de Command (CMD) .....                                                                                                          | 480 |
| Tableau E.6 – CDC: Mapping de Event Counting (CTE) .....                                                                                                   | 481 |
| Tableau E.7 – CDC: Mapping de State Timing (TMS) .....                                                                                                     | 482 |
| Tableau E.8 – CDC: Mapping de Device Name Plate (WDPL) .....                                                                                               | 483 |
| Tableau E.9 – CDC: Mapping de Alarm Set Status (AST) .....                                                                                                 | 484 |

## COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

---

### SYSTÈMES DE GÉNÉRATION D'ÉNERGIE ÉOLIENNE –

#### **Partie 25-4: Communications pour la surveillance et la commande des centrales éoliennes – Mapping pour les profils de communication**

#### AVANT-PROPOS

- 1) La Commission Électrotechnique Internationale (IEC) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de l'IEC). L'IEC a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. À cet effet, l'IEC – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de l'IEC"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec l'IEC, participent également aux travaux. L'IEC collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de l'IEC concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de l'IEC intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de l'IEC se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de l'IEC. Tous les efforts raisonnables sont entrepris afin que l'IEC s'assure de l'exactitude du contenu technique de ses publications; l'IEC ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de l'IEC s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de l'IEC dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de l'IEC et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) L'IEC elle-même ne fournit aucune attestation de conformité. Des organismes de certification indépendants fournissent des services d'évaluation de conformité et, dans certains secteurs, accèdent aux marques de conformité de l'IEC. L'IEC n'est responsable d'aucun des services effectués par les organismes de certification indépendants.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à l'IEC, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de l'IEC, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de l'IEC ou de toute autre Publication de l'IEC, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente Publication de l'IEC peuvent faire l'objet de droits de brevet. L'IEC ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de brevets et de ne pas avoir signalé leur existence.

La Norme internationale IEC 61400-25-4 a été établie par le comité d'études 88 de l'IEC: Systèmes de génération d'énergie éolienne.

Cette deuxième édition annule et remplace la première édition parue en 2008. Cette édition constitue une révision technique.

Cette édition inclut les modifications techniques majeures suivantes par rapport à l'édition précédente:

Harmonisation générale avec les modèles d'information de l'IEC 61400-25-2 et les services d'échange d'information de l'IEC 61400-25-3.

Réduction de l'écart entre les normes et simplification grâce à un référencement amélioré.

Pour les services web de l'Annexe A: les modifications sont limitées à l'harmonisation avec l'IEC 61850 et avec d'autres parties de l'IEC 61400-25. La mise à jour des services web pour l'utilisation de SOAP plutôt que de websockets a été prise en compte.

La maintenance du service OPC/XML-DA de l'Annexe B a inclus une évaluation de l'utilisation de propriétés d'éléments personnalisés. L'OPC UA n'a pas été choisie comme base pour l'IEC 61850-8-2. Toutefois, dans le cadre des travaux sur la TS 61400-25-41, l'OPC UA est actuellement envisagée pour remplacer le mapping pour OPC/XML-DA existant dans les éditions futures de l'IEC 61400-25-4. Par conséquent, la deuxième édition de l'IEC 61400-25-4 ne comprend pas de mapping pour OPC UA, mais cela pourrait faire l'objet d'un document séparé.

Le mapping de l'Annexe C pour l'IEC 61850-8-1 est harmonisé avec la dernière édition de l'IEC 61850-8-1.

Le mapping de l'Annexe D pour l'IEC 60870-5-104 inclut une harmonisation supplémentaire avec l'IEC 61850-80-1.

Enfin, le DNP3 de l'Annexe E est harmonisé avec la dernière édition de l'IEEE 1815-1. Elle comprend une adaptation pour la prise en charge des modèles spécifiques d'éoliennes.

- a) Le mapping des services AddSubscription et RemoveSubscription a été supprimé pour alignement avec l'IEC 61400-25-3.
- b) Les tableaux indiquant les services pris en charge ont été remplacés par des tableaux conformes à l'Annexe D de l'IEC 61400-25-3:2015 et comprenant les déclarations de conformité ACSI pour les clients et les serveurs, de façon individuelle.
- c) Les problèmes techniques (Tissues) de l'IEC 61850-7-2:2010 ont été pris en considération et des modifications ont été apportées en conséquence.
- d) Les problèmes techniques (Tissues), tels que rassemblés par le groupe d'utilisateurs USE61400-25 de l'IEC 61400-25, ont été pris en considération et des modifications ont été apportées en conséquence.
- e) Les modifications apportées à l'Annexe A incluent les éléments suivants: le mapping pour les classes d'objets a été supprimé pour les objets (Server, LD, LN, Data Set, RCB, UCB, LCB et Log) non utilisés dans les services. Les noms d'objets sont définis comme étant des noms de types complexes au lieu d'éléments. Les références erronées ont été supprimées. Les balises WSDL ont été renommées pour un meilleur alignement et une meilleure cohérence. Les valeurs de la taille maximale des messages sont indiquées. Le mapping pour le service GetAllDataValues a été ajouté. Des exemples de demandes et de réponses types de services ont été ajoutés. Une nouvelle version de WSDL a été créée et validée par XmlSpy.
- f) Les modifications apportées à l'Annexe B OPC/XML-DA ont été effectuées conformément à l'étendue de la révision. L'accent a été mis sur le mapping du type Array, du service GetAllDataValues, du modèle de rapport et des services de commande.
- g) La modification technique apportée à l'Annexe C est une adaptation des services de Profil TCP/IP selon les modifications apportées à l'IEC 61850-8-1:2011 (la redondance de communication et de liaison a été ajoutée).
- h) La modification la plus importante de l'Annexe D est la synchronisation avec la deuxième édition des normes IEC 61850 référencées. Conformément aux travaux réalisés sur l'Édition 2 de l'IEC 61850-80-1, les nouveaux CDC sont mappés pour l'IEC 60870-5-104. Une liste d'interopérabilité pour le mapping de l'IEC 61400-25-4 et de l'IEC 60870-5-104 a également été créée sous la forme d'un sous-ensemble de la liste d'interopérabilité de l'IEC 61850-80-1.
- i) L'Annexe E (DNP3) a été mise à jour afin d'utiliser la même approche que l'IEEE 1815.1. Elle décrit la façon de traduire les attributs des classes de données communes de l'IEC 61400-25-2 en points DNP3. L'utilisation d'ensembles de données DNP3 décrite

dans l'IEC 61400-25-4:2008 a été supprimée car elle n'offrait pas une approche suffisamment souple du mapping pour les informations de l'IEC 61400-25-2.

Le texte de cette norme est issu des documents suivants:

| FDIS        | Rapport de vote |
|-------------|-----------------|
| 88/600/FDIS | 88/607/RVD      |

Le rapport de vote indiqué dans le tableau ci-dessus donne toute information sur le vote ayant abouti à l'approbation de cette norme.

Cette publication a été rédigée selon les Directives ISO/IEC, Partie 2.

Une liste de toutes les parties de la série IEC 61400, publiées sous le titre général *Systèmes de génération d'énergie éolienne*, peut être consultée sur le site web de l'IEC.

Un fichier contenant le texte de l'Article A.7 est joint au présent document à l'intention des utilisateurs.

Le comité a décidé que le contenu de cette publication ne sera pas modifié avant la date de stabilité indiquée sur le site web de l'IEC sous "<http://webstore.iec.ch>" dans les données relatives à la publication recherchée. A cette date, la publication sera

- reconduite,
- supprimée,
- remplacée par une édition révisée, ou
- amendée.

**IMPORTANT – Le logo "*colour inside*" qui se trouve sur la page de couverture de cette publication indique qu'elle contient des couleurs qui sont considérées comme utiles à une bonne compréhension de son contenu. Les utilisateurs devraient, par conséquent, imprimer cette publication en utilisant une imprimante couleur.**

## INTRODUCTION

La série IEC 61400-25 définit les communications pour la surveillance et la commande des centrales éoliennes. L'architecture de la série IEC 61400-25 a été choisie de manière à fournir une définition abstraite des classes et services afin que les spécifications soient indépendantes des spécificités des piles de protocoles de communication, de leurs mises en œuvre et des systèmes d'exploitation. La présente partie de l'IEC 61400-25 spécifie le mapping de ces classes et services abstraits pour les piles de protocoles.

NOTE Les performances liées à la mise en œuvre de la série IEC 61400-25 sont spécifiques à l'application. La série IEC 61400-25 ne garantit pas un certain niveau de performance. Ce type de garantie ne relève pas du domaine d'application de la série IEC 61400-25. Toutefois, il n'y a pas de limitation sous-jacente à la technologie de communication qui interdit des applications à haut débit (réponses de l'ordre de la milliseconde).

## **SYSTÈMES DE GÉNÉRATION D'ÉNERGIE ÉOLIENNE –**

### **Partie 25-4: Communications pour la surveillance et la commande des centrales éoliennes – Mapping pour les profils de communication**

#### **1 Domaine d'application**

La série IEC 61400-25 concerne essentiellement les communications entre les composants des centrales éoliennes tels que les éoliennes et des acteurs tels que les systèmes SCADA. La communication interne entre les composants des centrales éoliennes ne relève pas du domaine d'application de la série IEC 61400-25.

La série IEC 61400-25 est conçue pour un environnement de communication fondé sur un modèle client-serveur. Trois domaines sont définis et ils sont modélisés séparément pour assurer l'extensibilité des systèmes mis en œuvre:

- a) le modèle d'information de centrale éolienne,
- b) le modèle d'échange d'information, et
- c) le mapping de ces deux modèles pour un profil de communication standard.

Le modèle d'information de centrale éolienne et le modèle d'échange d'information, considérés ensemble, constituent une interface entre le client et le serveur. Dans cette combinaison, le modèle d'information de centrale éolienne sert de trame pour interpréter les informations disponibles de la centrale éolienne. Le modèle d'information de centrale éolienne est utilisé par le serveur pour fournir au client une vue uniforme, orientée composant, des données de la centrale éolienne. Le modèle d'échange d'information représente toutes les fonctions actives du serveur. La série IEC 61400-25 permet de connecter entre eux une combinaison hétérogène de clients et de serveurs issus de différents constructeurs et fournisseurs.

Comme cela est représenté à la Figure 1, la série IEC 61400-25 définit un serveur ayant les aspects suivants:

- Les informations fournies par un composant de centrale éolienne, par exemple, la "vitesse de rotor d'une éolienne" ou la "production d'électricité totale durant un certain intervalle de temps" sont modélisées et rendues accessibles. Les informations modélisées dans la série IEC 61400-25 sont définies dans l'IEC 61400-25-2.
- Les services pour échanger les valeurs des informations modélisées définies dans l'IEC 61400 25-3.
- Le mapping pour un profil de communication, fournissant une pile de protocoles pour transporter les messages, c'est-à-dire les demandes et réponses de service et les valeurs provenant des informations modélisées (IEC 61400-25-4).

L'IEC 61400-25-5 définit les essais associés aux informations, services et piles de protocoles, pour les essais de conformité des serveurs comme des clients.

La série IEC 61400-25 définit uniquement la façon de modéliser les informations, l'échange d'information et le mapping pour des protocoles de communication spécifiques. La série IEC 61400-25 ne définit pas comment et où mettre en œuvre l'interface de communication, l'interface de programmation d'application et les recommandations de mise en œuvre. Toutefois, la série IEC 61400-25 a pour objet de permettre l'accès aux informations associées à un composant individuel de la centrale éolienne (tel qu'une éolienne) à travers un dispositif logique correspondant.


La présente partie de la série IEC 61400-25 indique les mappings spécifiques pour les piles de protocoles qui codent les messages exigés pour les échanges d'information entre un client et un serveur à distance, pour:

- l'accès et la récupération de données,
- la commande de dispositif,
- l'établissement de rapports et la journalisation,
- l'éditeur/l'abonné,
- l'autodescription des dispositifs (dictionnaire de données des dispositifs),
- l'établissement de types de données et la découverte des types de données.

Les mappings indiqués dans la présente partie de l'IEC 61400-25 comprennent:

- un mapping pour les services web basés sur SOAP,
- un mapping pour OPC/XML-DA,
- un mapping pour l'IEC 61850-8-1 MMS,
- un mapping pour l'IEC 60870-5-104,
- un mapping pour DNP3.

Tous les mappings sont facultatifs, mais il est nécessaire de sélectionner au moins un mapping facultatif afin d'être conforme à la présente partie de l'IEC 61400-25.

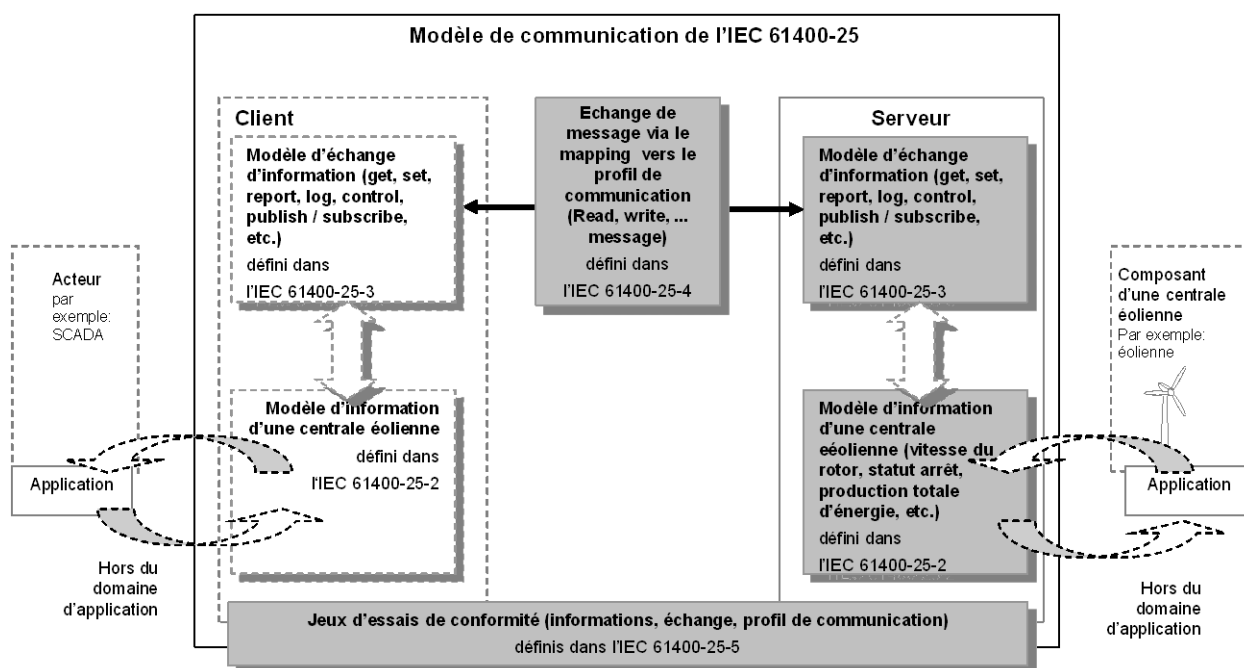

IEC

Figure 1 – Modèle de communication conceptuelle de la série IEC 61400-25

## 2 Références normatives

Les documents suivants cités dans le texte constituent, pour tout ou partie de leur contenu, des exigences du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

IEC 60870-5-4:1993, *Matériels et systèmes de téléconduite – Partie 5: Protocoles de transmission – Section 4: Définition et codages des éléments d'information d'application*

IEC 60870-5-5:1995, *Matériels et systèmes de téléconduite – Partie 5: Protocoles de transmission Section – Section 5: Fonctions d'application de base*

IEC 60870-5-101:2003, *Telecontrol equipment and systems – Part 5-101: Transmission protocols – Companion standard for basic telecontrol tasks* (disponible en anglais seulement)

IEC 60870-5-104:2006, *Matériels et systèmes de téléconduite – Partie 5-104: Protocoles de transmission – Accès aux réseaux utilisant des profils de transport normalisés pour la CEI 60870-5-101*

IEC 61400-25-1:2006, *Wind turbines – Part 25-1: Communications for monitoring and control of wind power plants – Overall description of principles and models* (disponible en anglais seulement)

IEC 61400-25-2:2015, *Eoliennes – Partie 25-2: Communications pour la surveillance et la commande des centrales éoliennes – Modèles d'information*

IEC 61400-25-3:2015, *Eoliennes – Partie 25-3: Communications pour la surveillance et la commande des centrales éoliennes – Modèles d'échange d'information*

IEC 61400-25-5:2006, *Wind turbines – Part 25-5: Communications for monitoring and control of wind power plants – Conformance testing* (disponible en anglais seulement)

IEC 61850-6:2009, *Communication networks and systems in substations – Part 6: Configuration description language for communication in electrical substations related to IEDs* (disponible en anglais seulement)

IEC 61850-7-2:2010, *Communication networks and systems for power utility automation – Part 7-2: Basic information and communication structure – Abstract communication service interface (ACSI)* (disponible en anglais seulement)

IEC 61850-7-3:2010, *Réseaux et systèmes de communication pour l'automatisation des systèmes électriques – Partie 7-3: Structure de communication de base – Classes de données communes*

IEC 61850-8-1:2011, *Réseaux et systèmes de communication pour l'automatisation des systèmes électriques – Partie 8-1: Mise en correspondance des services de communication spécifiques (SCSM) – Mise en correspondance pour MMS (ISO 9506-1 et ISO 9506-2) et pour l'ISO/CEI 8802-3*

IEC TS 61850-80-1:2008, *Communication networks and systems for power utility automation – Part 80-1: Guideline to exchanging information from a CDC-based data model using IEC 60870-5-101 or IEC 60870-5-104* (disponible en anglais seulement)

IEC 62439-3:2016, *Réseaux de communication industriels – Réseaux d'automatisme à haute disponibilité – Partie 3: Protocole de redondance en parallèle (PRP) et redondance transparente de haute disponibilité (HSR)*

ISO 639-2, *Codes pour la représentation des noms de langue – Partie 2: Code alpha-3*

ISO/IEC 8326:1996, *Technologies de l'information – Interconnexion de systèmes ouverts (OSI) – Définition du service de session*

ISO/IEC 8327-1:1996, *Technologies de l'information – Interconnexion de systèmes ouverts (OSI) – Protocole de session en mode connexion: Spécification du protocole*

ISO/IEC 8649:1996, *Information technology – Open Systems Interconnection – Service definition for the Association Control Service Element* (disponible en anglais seulement)

ISO/IEC 8650-1:1996, *Technologies de l'information – Interconnexion de systèmes ouverts (OSI) – Protocole en mode connexion applicable à l'élément de service de contrôle d'association: Spécification du protocole*

ISO/IEC 8822:1994, *Technologies de l'information – Interconnexion de systèmes ouverts (OSI) – Définition du service de présentation*

ISO/IEC 8823-1:1994, *Technologies de l'information – Interconnexion de systèmes ouverts (OSI) – Protocole de présentation en mode connexion: Spécification du protocole*

ISO/IEC 8824-1:2015, *Technologies de l'information – Notation de syntaxe abstraite numéro un (ASN.1): Spécification de la notation de base*

ISO/IEC 8825-1:2015, *Technologies de l'information – Règles de codage ASN.1: Spécification des règles de codage de base (BER), des règles de codage canoniques (CER) et des règles de codage distinctives (DER)*

ISO 9506-1:2003, *Systèmes d'automatisation industrielle – Spécification de messagerie industrielle – Partie 1: Définition des services*

ISO 9506-2:2003, *Systèmes d'automatisation industrielle – Spécification de messagerie industrielle – Partie 2: Spécification de protocole*

W3C, *Web Services Architecture*, <http://www.w3.org/TR/2002/WD-ws-arch-20021114/>

W3C, *Extensible Markup Language (XML) 1.0*, <http://www.w3.org/TR/2000/REC-xml-20001006>

SOAP ver. 1.1, *W3C Note Simple Object Access Protocol (SOAP) 1.1*, 8 May 2000. <http://www.w3.org/TR/2006/NOTE-soap11-ror-httpbinding-20060321/#reqoptrespbinding> et <http://www.w3.org/TR/2000/NOTE-SOAP-20000508/>  
(Référéncé à l'Annexe B)

SOAP ver. 1.2, *W3C*, 27. April 2007: <http://www.w3.org/TR/soap>  
(Référéncé à l'Annexe A)

RFC 791, *Internet Protocol specification (IP)*

RFC 792, *Internet Control Message Protocol (ICMP)*

RFC 793, *Transmission Control Protocol (TCP)*

RFC 826, *Ethernet Address Resolution Protocol*

RFC 919, *Broadcasting internet datagrams*

RFC 922, *Broadcasting internet datagrams in presence of subnets*

RFC 950, *Internet Standard Subnetting Procedure*

RFC 1006, *ISO Transport Service on top of the TCP Version: 3*

RFC 1112, *Host Extensions for IP Multicasting*

RFC 1122, *Requirements for Internet Hosts – Communication Layers*, IETF

RFC 2200, *Internet Official Protocol Standards, Request for Comments 2200*, June 1997

RFC 2616, *Hypertext Transfer Protocol – HTTP/1.1*

RFC 2817, *Upgrading to TLS Within HTTP/1.1*

RFC 4122, *Universally Unique Identifier (UUID) URN Namespace*

RFC 5246, *Transport Layer Security (TLS version 1.2) protocol*

OPC XML-DA Specification. Version 1.01, 18 December 2004

IEEE Std 754:1985, *IEEE Standard for Binary Floating-Point Arithmetic*

IEEE 802.1D:2004, *IEEE Standard for Local and Metropolitan Area Networks: Media access control (MAC) Bridges*

IEEE P1815.1:2015, *Standard for exchanging Information between networks implementing IEC 61850 and IEEE Std 1815 (Distributed Network Protocol – DNP3)*