



IEC 63552

Edition 1.0 2026-06

# INTERNATIONAL STANDARD

---

**Switching device for islanding (SDFI)**

## CONTENTS

FOREWORD.....	3
INTRODUCTION.....	5
1 Scope.....	7
2 Normative references .....	8
3 Terms and definitions .....	9
4 Classification.....	13
4.1 General.....	13
4.2 According to the construction.....	14
4.3 According to the method of integration of SRCSD .....	14
4.4 According to the method of operation.....	15
4.5 According to kind of current .....	15
4.6 According to the number of switched poles .....	15
4.7 According to SRCSD interlocking means.....	15
4.8 According to the reclosing mode .....	15
4.9 According to islanding means .....	15
4.10 According to the type of isolation .....	15
4.11 According to the type of local sources.....	15
5 Characteristics .....	16
6 Markings and product information.....	16
7 Standard conditions for operation in service .....	17
8 Requirements for construction and operation.....	18
8.1 General requirements .....	18
8.2 Construction requirements.....	19
8.2.1 Mechanism .....	19
8.2.2 SDFI operation and interlocking.....	19
8.2.3 Manual reclosing of the SDFI.....	21
8.2.4 Voltage and frequency deviations .....	22
8.2.5 Voltage withstand between open contacts .....	22
8.3 Reclosing operations (reconnection to grid connected mode).....	22
8.4 Operational endurance.....	24
8.5 EMC .....	24
9 Type tests .....	24
9.1 General.....	24
9.2 SDFI operation and interlocking.....	24
9.3 Tests for manual reclosing .....	25
9.4 Verification of operations upon deviations .....	25
9.5 Test for reclosing operations.....	26
9.5.1 General .....	26
9.5.2 SDFI provided for closing without synchronization .....	26
9.5.3 SDFI provided for reclosing with synchronization .....	27
9.6 EMC tests .....	28
9.6.1 General .....	28
9.6.2 Electromagnetic emission .....	28
9.6.3 Electromagnetic immunity.....	28
Bibliography.....	30

Figure 1 – Example of islandable PEI architecture .....	6
Figure 2 – Example of SDFI architecture.....	14
Figure 3 – SDFI operation principle.....	20
Figure 4 – Example of architecture of a PEI operating in TT in connected mode and becoming TN in island mode .....	21
Figure 5 – Example of sequence diagram for operation upon source deviation and grid loss for transition to island mode .....	22
Figure 6 – Grid reconnection – without synchronization (open transition) .....	23
Figure 7 – Grid reconnection – with synchronization (closed transition) .....	23
Figure 8 – Example of typical undervoltage ride through capability profile.....	26
Table 1 – Requirements and position for markings and other product information .....	16
Table 2 – Values of influencing quantities .....	18
Table 3 – Immunity tests and performance criteria.....	29
Table 4 – Performance criteria .....	29

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**Switching device for islanding (SDFI)**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch>. IEC shall not be held responsible for identifying any or all such patent rights.

IEC 63552 has been prepared by subcommittee 23K: Electrical energy efficiency products, of IEC technical committee 23: Electrical accessories. It is an International Standard.

The text of this International Standard is based on the following documents:

Draft	Report on voting
23K/133/FDIS	23K/135/RVD

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at [www.iec.ch/members\\_experts/refdocs](http://www.iec.ch/members_experts/refdocs). The main document types developed by IEC are described in greater detail at [www.iec.ch/publications](http://www.iec.ch/publications).

In this document, the following print types are used:

- *conformity statements: in italic type.*

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under [webstore.iec.ch](http://webstore.iec.ch) in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn, or
- revised.

## INTRODUCTION


IEC 60364-8-82 aims to ensure that low-voltage electrical installations are compatible with both current and future methods for safely and effectively delivering electrical energy to current-using equipment, regardless of whether the energy comes from Distribution System Operator (DSO) or local generation. IEC 60364-8-82 provides requirements and recommendations for low-voltage electrical installations, whether or not they are connected to a distribution network, and are capable of operating:

- with either local power supplies,
- or with local storage units,
- or with both,

and that monitors and controls the energy from the locally connected sources delivering it to:

- either current-using equipment,
- or local storage units,
- or distribution networks.

Such electrical installations are designated as prosumer's electrical installations (PEIs) by IEC 60364-8-82 which defines specific devices (or functions) to ensure the correct and safe operation of PEI depending on their operating mode. In the case of an islandable PEI, IEC 60364-8-82 defines a "Switching Device For islanding (SDFI)", identified as device 4 in Figure 1.

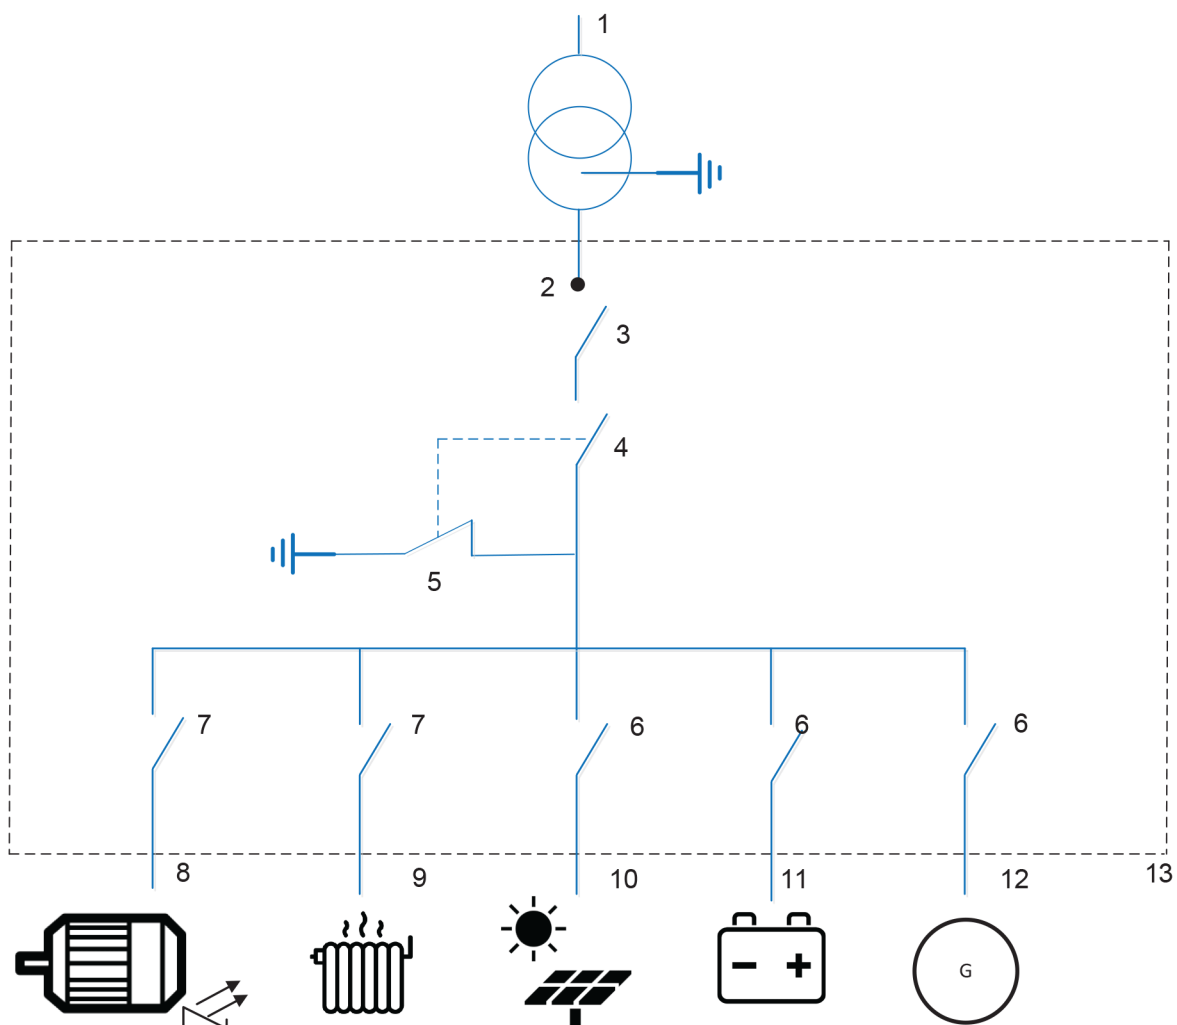

IEC

**Key**

- |   |   |    |                                       |
|---|---|----|---------------------------------------|
| 1 | Distribution network                          | 8  | Non-sheddable loads (sensitive loads) |
| 2 | Point of connection (POC)                     | 9  | Sheddable loads (adjustable loads)    |
| 3 | Main switching device                         | 10 | Solar generator                       |
| 4 | Switching device for islanding (SDFI)         | 11 | Electrical energy storage system      |
| 5 | System referencing conductor switching device | 12 | Other generator (wind, etc.)          |
| 6 | Source switching device                       | 13 | Main distribution board               |
| 7 | Load switching device                         |    |                                       |

SOURCE: IEC 60364-8-82:2022, Figure 4.

**Figure 1 – Example of islandable PEI architecture**

The objectives of this document is to define the functions, requirements and tests of a SDFI in line with the requirements stated in IEC 60364-8-82.

## 1 Scope

This document applies to switching device for islanding, hereafter referred to as SDFI, for household and similar uses, primarily intended to be used for energy efficiency (EE) purposes with local production or local storage of energy, or with both.

SDFI are intended to be installed in low voltage prosumer electrical installations (PEI) able to operate in island mode as defined in IEC 60364-8-82, so called islandable PEI.

SDFI are used to disconnect the PEI from the grid to allow operating the PEI in island mode and further reconnect the PEI to the grid.

They are intended to be used in islandable PEI which operate:

- in connected mode (direct feeding mode or reverse feeding mode), and
- in island mode,

as defined in IEC 60364-8-82.

NOTE 1 See definitions 3.10 and 3.13 of island mode and for connected mode respectively.

NOTE 2 Switching of a PEI to island mode can be subject to local regulations (grid codes) or to specific agreement with system operators. Reverse feeding is also usually subject to local regulations (grid codes).

SDFI are part of the electrical installation.

This document applies to SDFI for operation in AC single or multiphase main circuits with rated voltages not exceeding 440 V AC, frequencies of 50 Hz, 60 Hz or 50/60 Hz. They are intended to be used in installations with prospective short circuit currents not exceeding 25 000 A.

NOTE 3 DC operations are not covered by this edition and are kept under consideration for a future revision of this document.

The SDFI is composed at least of one switching unit (SU) and a control unit (CU) to monitor its switching operations from grid connected to island mode and reverse wise.

The SDFI can be provided with a communication interface for exchange with external systems such as the Customer Energy Manager (CEM) defined in IEC 63402 series.

According to the intended use, the SDFI can be interlocked with a system referencing conductor switching device (SRCSD) according to IEC 63445 or it can be integrated with a SRCSD in a single unit.

NOTE 4 According to its intended use, the SDFI can also be used as an interface switch with the interface protection (integrated or not). See 3.19 and 3.20.

SDFI are intended for use in circuits where protection against electrical shock and overcurrent is provided according to installation rules for low voltage electrical installations, unless the SDFI already contains such protective function. SDFI are not requested to provide isolation function and overcurrent protection according to IEC 60364-8-82. However, the isolation function can be provided by a SDFI fulfilling the requirements of the relevant product standards.

SDFI are installed by instructed persons (IEC 60050-195:2021, 195-04-02) or skilled persons (IEC 60050-195:2021, 195-04-01). They are intended to be used by ordinary persons (IEC 60005-195:2021, 195-04-03) and do not require maintenance.

It is important to note that the main overcurrent protective device of installations cannot be used as a SDFI in single dwellings or similar islandable PEI (see Clause D.5 of IEC 60364-8-82:2022)

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60364-8-82:2022, *Low-voltage electrical installations - Part 8-82: Functional aspects - Prosumer's low-voltage electrical installations*

IEC 60669-2-4, *Switches for household and similar fixed electrical installations - Part 2-4: Particular requirements - Isolating switches*

IEC 60898-1:2015, *Electrical accessories - Circuit-breakers for overcurrent protection for household and similar installations - Part 1: Circuit-breakers for a.c. operation*

IEC 60898-2, *Electrical accessories - Circuit-breakers for overcurrent protection for household and similar installations - Part 2: Circuit-breakers for AC and DC operation*

IEC 60947-2, *Low-voltage switchgear and controlgear - Part 2: Circuit-breakers*

IEC 60947-3, *Low-voltage switchgear and controlgear - Part 3: Switches, disconnectors, switch-disconnectors and fuse-combination units*

IEC 60947-10, *Low-voltage switchgear and controlgear - Part 10: Semiconductor circuit-breakers<sup>1</sup>*

IEC 61000-4-2, *Electromagnetic compatibility (EMC) - Part 4-2: Testing and measurement techniques - Electrostatic discharge immunity test*

IEC 61000-4-3, *Electromagnetic compatibility (EMC) - Part 4-3: Testing and measurement techniques - Radiated, radio-frequency, electromagnetic field immunity test*

IEC 61000-4-4, *Electromagnetic compatibility (EMC) - Part 4-4: Testing and measurement techniques - Electrical fast transient/burst immunity test*

IEC 61000-4-5, *Electromagnetic compatibility (EMC) - Part 4-5: Testing and measurement techniques - Surge immunity test*

IEC 61000-4-6, *Electromagnetic compatibility (EMC) - Part 4-6: Testing and measurement techniques - Immunity to conducted disturbances, induced by radio-frequency fields*

IEC 61000-4-8, *Electromagnetic compatibility (EMC) - Part 4-8: Testing and measurement techniques - Power frequency magnetic field immunity test*

IEC 61000-4-11, *Electromagnetic compatibility (EMC) - Part 4-11: Testing and measurement techniques - Voltage dips, short interruptions and voltage variations immunity tests for equipment with input current up to 16 A per phase*

IEC 61000-6-1, *Electromagnetic compatibility (EMC) - Part 6-1: Generic standards - Immunity standard for residential, commercial and light-industrial environments*

---

<sup>1</sup> Under preparation. Stage at the time of publication: IEC FDIS 60947-10:2025.

## Bibliography

IEC 60050-195:2021, *International electrotechnical vocabulary (IEV) - Part 195: Earthing and protection against electric shock*, available at <http://www.electropedia.org>

IEC 60050-617:2009, *International Electrotechnical Vocabulary - Part 617: Organization/market of electricity*, available at <http://www.electropedia.org>

IEC 60050-692:2017 *International electrotechnical vocabulary - Part 692: Generation, transmission and distribution of electrical energy - Dependability and quality of service of electric power systems*, available at <http://www.electropedia.org>

IEC 60364 (all parts), *Low-voltage electrical installations*

IEC 60364-8-1:2019, *Low-voltage electrical installations - Part 8-1: Functional aspects - Energy efficiency*

IEC 60947-6-1:2021, *Low-voltage switchgear and controlgear - Part 6-1: Multiple function equipment - Transfer switching equipment*

IEC TS 62786-1:2023, *Distributed energy resources connection with the grid - Part 1: General requirements*

IEC 63402 (all parts), *Energy Efficiency - Customer Energy Management Systems*

IEC 63402-1:2025, *Energy Efficiency - Customer Energy Management Systems - Part 1: General Requirements and Architecture*

EN 50549-1, *Requirements for generating plants to be connected in parallel with distribution networks - Part 1: Connection to a LV distribution network - Generating plants up to and including Type B*

EN 50549-2, *Requirements for generating plants to be connected in parallel with distribution networks - Part 2: Connection to a MV distribution network - Generating plants up to and including Type B*

---